


ROTAN PUMP

Types GP – HD - PD - CD - CC - ED*

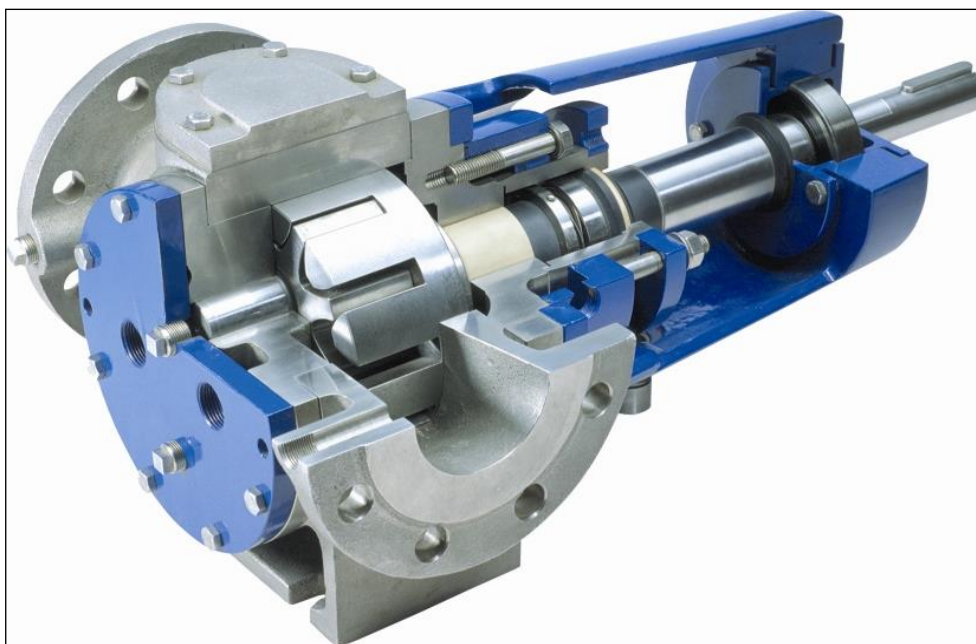

DESMI Inc.

Tel.: +1 757 857-7041
Fax: +1 757 857-6989
E-Mail: info@desmiusa.com
Internet: www.desmiusa.com

T1456US V.9.4

EC Declaration of Conformity

The Machinery Directive 2006/42/EC

Manufacturer: DESMI A/S
Address: Tagholm 1, DK-9400 Nørresundby, Denmark
Tel.: +45 96 32 81 11
E-mail: desmi@desmi.com



DESMI A/S hereby declares that the product in question has been produced in accordance with the following essential health and safety requirements of the Machinery Directive 2006/42/EC Annex I.

Product: ROTAN pumps complete with motor
Type: HD, CD, PD, GP, CC, ED(MD)

which are installed and applied in conformity with DESMI A/S' user manual.

The following harmonised standards have been applied:
EN 294:1994 Safety distances
EN 809:2002 + AC – Pumps and pump units for liquids
EN 12162:2001 – Procedures for hydrostatic testing of liquid pumps
EN 60204-1:2006 Electrical equipment on machines (item 4, general requirements)

Reservations For application in explosive atmospheres the pump with motor must also comply with ATEX Directive 94/9/EC.
If applied for hazard-classified liquids, the user company's attention is drawn to the section of the user manual on emptying and cleaning of the pump.



Nørresundby 2010

A handwritten signature in black ink, appearing to read 'Kurt Bech Christensen'.

Kurt Bech Christensen
Technical Director
DESMI A/S

Component Declaration

Manufacturer: DESMI A/S
Address: Tagholm 1, DK-9400 Nørresundby, Denmark.
Tel.: +45 96 32 81 11
E-mail: desmi@desmi.com

Product: ROTAN pumps
Type: HD, CD, PD, GP, CC, ED(MD)

which are installed and applied in conformity with DESMI A/S' user manual

DESMI A/S hereby declares that the product in question has been produced in accordance with the essential health and safety requirements of the Machinery Directive 2006/42/EC Annex I.

The following harmonised standards have been applied:
EN 294:1994 Safety distances
EN 809:2002 + AC – Pumps and pump units for liquids
EN 12162:2001 – Procedures for hydrostatic testing of liquid pumps

The pump is designed for use when connected to an electric motor, with the aim of creating a joint machine.

Reservation For application in explosive atmospheres the pump must also comply with ATEX Directive 94/9/EC.

If applied for hazard-classified liquids, the user company's attention is drawn to the section of the user manual on emptying and cleaning of the pump.

The pump must not be put into use until pump, motor and control have been risk assessed and the unit has been CE marked in conformity with the provisions of the Machinery Directive.



Nørresundby 2010

A handwritten signature in black ink, appearing to read "KBC", written over a horizontal line.

Kurt Bech Christensen
Technical Director
DESMI A/S

EU Declaration of Conformity ATEX – 2014/34/EU

Manufacturer: DESMI Pumping Technology A/S
Address: Tagholm 1, DK-9400 Nørresundby, Denmark.
Tel.: +45 96 32 81 11
E-mail: desmi@desmi.com



Product: ROTAN pumps
Type: HD, CD, PD, GP, CC, ED(MD)
Size: DN25 – DN200 / 1" – 8"

which are marked: ⚡ II category 2 or 3, "c" X, with temperature class, and installed and applied in conformity with DESMI Pumping Technology A/S' user manual

The entire user manual must be read thoroughly before a ROTAN ATEX pump is installed and put into use

DESMI Pumping Technology A/S hereby declares that the product in question has been produced in accordance with ATEX Directive 2014/34/EU.

The following harmonised standards have been applied:
ISO 80079-36:2016
ISO 80079-37:2016

The product is designed for connection to an electric motor with the aim of making a complete unit. The conformity also applies to complete pumps with motor if, according to the manufacturer, the motor conforms to a corresponding category and temperature class and it has been fitted in conformity with DESMI Pumping Technology A/S' user guide.

If the pump and electric motor are supplied by DESMI Pumping Technology A/S as a complete unit, the EU Declaration of Conformity and user manual for the electric motor will be attached.

The technical file is stored at: PTB(Physikalisch – Technische Bundesanstalt) Braunschweig und Berlin.
Reg. number 03 ATEX D052.

Nørresundby, 2018


Henrik Mørkholt Sørensen
Managing Director
DESMI Pumping Technology A/S

Contents


Name plate	1
General information	2
1. EC declaration of conformity	10
2. Safety warnings – in general	11
3. Safety warnings – Electrical	13
4. Safety warnings – ATEX	13
5. Pump models	14
5.1 Pump models	15
5.2 Pump Versions	16
6. Transporting the pump	17
7. Lifting the pump	17
8. Storage, long-term preservative and frost protection of the pump	21
8.1 Storage	21
8.2 Preservation procedure	22
8.3 Frost protection	22
9. Installation	23
9.1 Selecting the motor etc.	23
9.2 Connection the motor and the pump	23
9.3 Aligning the motor and the pump	24
9.4 Axial clearance	24
9.5 Horizontal/vertical position of the pump	25
9.5.1 Horizontal positioning of the pump	25
9.5.2 Vertical positioning of the pump	26
9.6 Positioning of the pump foundation	27
9.7 Before connecting the pipes	29
9.7.1 External loads on pump flanges	29
9.7.2 Flange coupling	31
9.7.3 Threaded coupling	32
9.8 Dry running	32
9.9 Thermal sensor	33
9.10 Emergency stop	34
9.11 Electric coupling	35
9.12 Monitoring	35
10. Before starting the pump	36

10.1	Before starting after preservation	37
11.	After starting the pump	38
11.1	Cavitation	38
11.2	Running in the soft seal – when starting the pump	40
12.	Bypass valve	41
12.1	Valve configuration	43
12.2	positioning the valve	43
12.3	operating principle – valve	44
12.4	Setting the bypass valve	46
13.	Pump liquids	50
13.1	Hot liquids	50
13.2	Foods	52
14.	Noise	52
15.	Storing the user manual	54
16.	Maintenance	54
16.1	Adjusting the soft shaft seal	56
16.1.1	Repacking – soft shaft sea	57
16.2	Ball bearings	58
16.2.1	Lubrication of the ball bearing	58
16.2.2	Service life ball bearings	60
16.3	Lubrication of slide bearings	62
17.	Troubleshooting	65
18.	Emptying and cleaning the pump	66
19.	Disposal of liquid	67
20.	Repairs	68
20.1	Reinstallation of thermal sensor	68
20.2	Axial clearance	69
20.1.1	Checking the axial clearance	70
20.2.2	Setting the axial clearance	71
21.	Spare parts	76
22.	Ordering spare parts	76
22.1	Spare parts drawings	76
23.	Spare parts list	80
24.	Technical specifications	82
24.1	Capacity	83
24.2	Speed	83
24.3	operating pressure	84

24.4	Suction height	84
24.5	Viscosity	84
24.6	Temperature	85
25.	Installation of ATEX pumps with PT100 sensor	86
25.1	Installation of PT100 sensor	86
25.1.1	PT100 sensor installed in intrinsically safe electrical circuit	86
25.1.2	PT100 sensor installed as intrinsically safe equipment	86
25.2	Installation of PT100 sensor on the pump	86
25.2.1	Pumps with soft shaft seal	87
25.2.2	ED pumps	87
25.2.3	Bypass valve	87
26.	Service centres – Denmark	88
27.	Subsidiary companies – DESMI A/S	89

***ED operations and service instructions. See manual T1386**

Name plate

ROTAN [®] PUMP			
SX.		NO.	
VALVE		SEAL	
	THE DESMI GROUP		CE
www.desmi.com			
MADE BY DESMI		YEAR:	

The above shows the name plate fixed on the ROTAN pump.

If the pump's and the motor's name plate bears an  and the designation **group II, zone 2 or 3, G or GD, c X and T-classes – e.g. II 3 GD c T4 X -**, the unit is prepared for use in a potentially explosive environment.

Standard ROTAN pump units are not prepared to use in a potentially explosive environment.



The name plate must **never** be removed from the pump.

If the name plate is removed, the pump cannot be identified immediately, and therefore warnings in this manual cannot be compared with the specific pump application.

The pump's order number and serial number are displayed on the flange.

General information

This user manual relates to ROTAN internal gear pumps.

The entire user manual must be read thoroughly before the pump is transported, lifted, installed, assembled and any other activity described in this user manual.

Everyone who is to work with this pump must read this user manual before it is taken into operation.

Upon receipt, check that the delivery is complete and undamaged. Any deficiencies or damage must be reported immediately to the transport company and the supplier, in order that a claim may be valid.

The user is responsible for compliance with the safety requirements described in this user manual.

If people who are expected to have a need to refer to the user manual are of a different linguistic origin than the language in which the user manual has been supplied, it is recommended that the user manual is translated into the language in question.

In addition to the instructions contained in this user manual, we also refer to the prevailing local national laws and regulations. The user is responsible for compliance with these.

The owner of the pump is responsible for ensuring that everyone who works with the pump has the necessary background.

In the event that this user manual or other regulations recommend the use of personal protective equipment or limitations on the use of labour and the pump, such instructions must be observed.

The pump may only be used under the operating conditions specified when the order was placed. Any deviation from this requires DESMI's consent.

The owner or user of the pump must ensure that this manual is updated if there are any modifications to the pump. Especially the description of safety must be emphasised.

In the event that the pump is transferred to a third party, this user manual with any updated amendments and the operating conditions defined when the order was submitted *must* accompany the pump.

DESMI assumes no liability for any personal injury or damage to the pump or other material damage resulting from:

- any amendments to the pump not approved by DESMI A/S
- a failure to observe the safety regulations or other instructions in this user manual
- the use of non-original spare parts that do not satisfy precisely the same, strict quality requirements as original DESMI spare parts
- any fault, blockage or breakdown in the pipe system

The owner or user is responsible for protecting the pipe system against faults, blockages and explosions.

Quality management system:

ROTAN pumps are manufactured in accordance with DESMI's quality management system, which is certified by BVQI in accordance with the requirements of ISO 9001.



Testing of pumps:

All ROTAN pumps have been *statically* and *dynamically* tested in the factory except pump versions "CHD" and "EPDM".

All bypass valves have been *statically* tested in the factory.

Static pressure testing is conducted to ensure that the pumps do not leak, and that they can maintain the specified maximum operating pressure.

The dynamic test is conducted to ensure that the pump can deliver the specified volume of liquid at the specified pressures.

The pumps are tested and preserved with oil type GOYA 680 transmission oil (Q8) with a viscosity of about 70 cSt. Pumps in versions "CHD" and "EPDM" are preserved in the factory using vegetable oil.

Pumps fitted with a heating jacket/cooling jacket are also specially tested to achieve extra safety to ensure that the heating liquid in the front cover and the cooling jacket on the rear cover cannot pass into the pump liquid.

After testing the pump is emptied, but it has not been cleaned for test oil in the factory.

All pumps are supplied with a signed test certificate.

The tests described are conducted in accordance with the procedures set out in DESMI's quality management system and in accordance with international classification companies.

Explosion-proof pumps:

DESMI produces pump units for potentially explosive environments, but as a standard ROTAN pump units are not prepared for use in potentially explosive environments, and therefore they must not be used in such contexts without DESMI's consent. The information on the pump's name plate will define whether it can be used in a potentially explosive environment.

DESMI can supply pump units for potentially explosive environment within the areas indicated in Figure 1: Shows the group (G=Gas/D=Dust), the categories, zones and temperature classes (T1/T2/T3/T4) for which DESMI A/S can supply pump units within potentially explosive environments.

Atex			
Group II - G/D			
Category 2		Category 3	
Zone 1	Zone 21	Zone 2	Zone 22
Gas / steam / mist	Dust	Gas / steam / mist	Dust
T1 / T2 / T3 / T4 /			

Figure 1: Shows the group (G=Gas/D=Dust), the categories, zones and temperature classes (T1/T2/T3/T4) for which DESMI A/S can supply pump units within potentially explosive environments.

If the pump is required to be used in a potentially explosive environment, this must be stated when ordering so that the pump unit can be supplied especially for such conditions.

DESMI A/S can supply the following control equipment to pumps in a potentially explosive environment:

Control equipment	Protection
Thermal sensor	For registration of surface temperature (to be connected to control)
Temperature labels	Temperature labels indicate the max. temperature reached
Bypass valve	The bypass valve protects pumps and motors in the event of brief pulsating excess pressures in the system. The bypass valve does not give protection against the pipe system
Liquiphant™	The Liquiphant™ provides protection against dry running



All pump types and pump sizes must always be protected against dry running either by means of a Liquiphant™ or other comparable devices



Pumps supplied with a soft stuffing box must always be fitted with a thermal sensor or other comparable devices



Pump type ED must always be fitted with a thermal sensor

Temperature labels can be used as extra control together with the thermal sensor. However, the thermal sensor cannot be replaced by temperature labels. When using temperature labels, the manufacturer's instructions must be observed.

Any other issues in connection with purchase of pump units for potentially explosive environments are to be clarified with our sales department when ordering.

Before ordering, you must first as a customer fulfil the minimum requirements in the current, relevant EF ATEX Directive concerning improvement of safety and health protection for employees who may be exposed to danger resulting from potentially explosive environments and have prepared an overall risk assessment in conformity with the mentioned directive in collaboration with the local fire authorities. This risk assessment must be in conformity with the ATEX labelling DESMI A/S has stated on the name plate of the supplied pump – before start-up of the pump is allowed.



Prepare an overall risk assessment must be in conformity with the current relevant EC Directives on potentially explosive atmosphere in collaboration with the local fire authorities – if the pump is to be used in a potentially explosive atmosphere – and check that this risk assessment against the labelling DESMI A/S has stated on the supplied pump before commissioning of the pump is allowed.

Special protective measures for ROTAN pump units in connection with potentially explosive environments to be considered and observed appear continuously from this manual under the relevant sections – see these!

*

Flow:

The sketch below shows a cross section of the ROTAN pump seen from the front end – see Figure 2.

The sketch shows the principle of the liquid flow through the ROTAN pump.

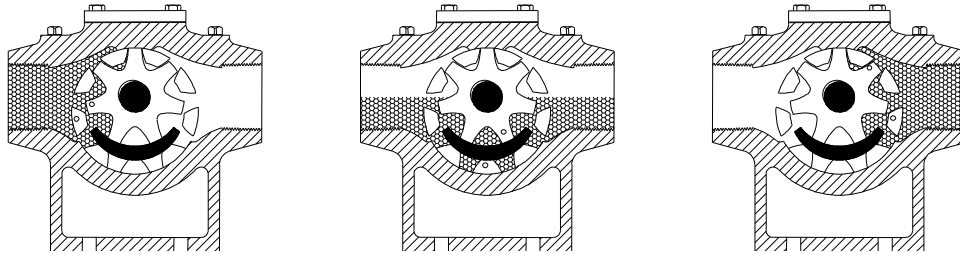


Figure 2: Shows the liquid flow through the ROTAN pump – seen from the front end.

Pump versions:

This user guide covers all standard versions of the ROTAN pump.

It applies to pump types described in Figure 4: A list of the various pump types, their designation and application.

, pump sizes described in Figure 5: A list of pump sizes based on the internal diameter of the pump's inlet/outlet in inches and millimetres.

, pump versions described in the section entitled "Pump models",

and the versions shown in Figure 8: The codes of the various pump versions together with an explanation of what they mean.

In this manual the front and the rear ends of the ROTAN pump are referred to. shows which end is called front and which is called rear.

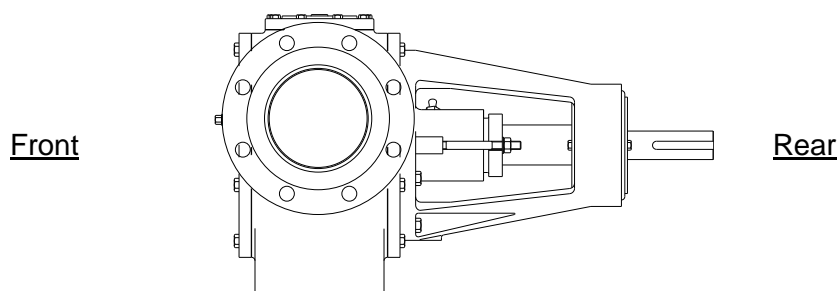


Figure 3: Shows what is designated as front and rear of the ROTAN pump.

The ROTAN pump has a modular construction, and can be supplied in a great number of options.

Because of the large number of possible combinations, it is not possible to cover all models or special versions available in this user manual.

If the user manual proves to be incomplete with regard to the above or to the item supplied, you are of course welcome to contact DESMI.

This user manual differentiates between the terms:

- pump types
- pump sizes
- pump models
- pump versions

Pump types:

The Rotan pump is supplied in the following pump types:

Pump types - application		
Pump type:	Designation:	Application:
GP	General Purpose	Mainly pumping of clean oils
HD	Heavy Duty	Mainly pumping of highly viscous liquids <u>Typical applications:</u> oils, asphalt, chocolate, paint, lacquer, molasses, soap and similar liquids <u>Used for processes in:</u> process industry
PD	Petrochemical Duty	<u>Typical applications:</u> lubricating oil, petrol, lubricants and other hydrocarbons. <u>Used for processes in:</u> refineries and the petrochemical industry
CD	Chemical Duty	To pump corrosive liquids <u>Typical applications:</u> organic acids, fatty acids, alkalis, caustic soda, polymer solutions, soap, shampoo, animal fat, vegetable fat, chocolate and other special liquids <u>Used for processes in:</u> chemical industry, food industry and the cosmetic industry
ED	Magnetic Drive	Used to pump all the above liquids ED pumps are particularly environment-friendly, and provide a 100% guarantee against liquid or air leakage
CC	Closed Coupled	Particularly for pumping oil products <u>Used for processes in:</u> engineering industry

Figure 4: A list of the various pump types, their designation and application.

Pump sizes:

The ROTAN pump is supplied in various pump sizes.
The pump size is defined on the basis of the pump's inlet/outlet.

By measuring the internal diameter of the pump's inlet/outlet, you can find the pump size in the table below.

Pump size		
Pump sizes	Nominal diameter i mm.	Internal diameter in inches
26	25	1"
33	32	1 1/4"
41	40	1 1/2"
51	50	2"
66	65	2 1/2"
81	80	3"
101	100	4"
126	125	5"
151*	150	6"
152*	150	6"
201	200	8"

Figure 5: A list of pump sizes based on the internal diameter of the pump's inlet/outlet in inches and millimetres.
*Pump sizes 151 and 152 are pumps of two different displacements, but with the same size inlet/outlet.

The various pump types are available in the pump sizes listed in Figure 6: A list of the various pump sizes together with the pump types available in the various pump sizes.

Pump types/sizes						
Pump size	Pump types					
	GP	HD	PD	CD	ED	CC
26						
33						
41						
51						
66						
81						
101						
126						
151						
152						
201						

Figure 6: A list of the various pump sizes together with the pump types available in the various pump sizes.
Fields that are shaded grey indicate the sizes available in the pump types listed.
The pump's inlet/outlet can be supplied with internal threads or flanges.

All pump types and pump sizes can be supplied with flanges to match connecting objects. The pump is supplied with an internal thread in the pump types and pump sizes listed in Figure 7.

Pump size	Pumps with internal thread						
	GP	HD	PD	Pump types		ED	CC
				CD	stainless		
26							
33							
41							
51							
66							
81							
101							
126							
151							
152							
201							

Figure 7: A list of the various pump sizes and pump types supplied with an internal thread. Fields that are shaded grey indicate the pump types and pump sizes supplier with an internal thread.

Heating/cooling jackets:

Rotan pumps can be fitted with a heating jacket or a cooling jacket on the front cover and/or the rear cover. Heating jackets are used to keep the pump liquid fluid, and are often necessary when pumping highly viscous liquids or liquids that tend to coagulate. The heating jacket on the rear cover can also be used to heat liquid-lubricated shaft seals.

The jacket can also be used as a cooling jacket for the shaft seal on the rear cover or a cooling jacket to cool the pump liquid on the front cover.

We recommend that the pump be heated before operation.

The heating/cooling chambers are heated or cooled by connecting a separate circulatory system that circulates heating liquids such as water, steam or oil.



The pressure in the heating jacket on the front cover and the cooling jacket on the rear cover may not exceed 10 bar.



The liquid in the heating chambers must have an ignition temperature of at least 50°C/122°F above the pump's maximum surface temperature.

1. EC Declaration of Conformity

ROTAN pumps are CE-labelled from the factory and supplied with an EC Declaration of Conformity or an EC Component Declaration – depending on whether the pump has been bought with or without a motor.

When fitting a ROTAN pump in an existing system and connecting pumps and motors, we would point out that the whole plant/combination of motor and pump must be assessed and given a new CE label in order to ensure that the combination represents no new hazards with regard to health and safety.



Please note that pumps supplied by DESMI without a motor must be connected using an explosion-proof motor if you intend to use the pump in a potentially explosive atmosphere.

A ROTAN pump may not be put into operation until this CE labelling procedure has taken place. The manufacturer that ultimately assembles the final system is responsible for ensuring that such compliance is achieved. DESMI is not responsible for this compliance.

The above requirement is valid within the EC.



2. Safety warnings – in general

- The pressure in the heating jacket on the front cover and the cooling jacket on the rear cover may not exceed 10 bar/145 psi.
- Lift the pump mechanically, if the pump's weight is more than the permitted number of kilos/ pounds that people may lift.
- Do not place fingers in the pump's ports when lifting or handling the pump.
- Motors fitted with lifting eyes must not be used to lift the whole pump, but only to lifting the motor separately.
- Lift of the pump should be performed in stable suspension points so that the pump is balanced and the lifting straps are not placed over sharp edges
- Lift of the pump shall be performed in conformity with the lifting instructions in Figure 10 – Figure 12
- Carefully shield the coupling between the pump and motor
- Bolt the pump securely to the foundation.
- Clean out any impurities from the pipe system before the pump is connected to it
- Remove the protective plugs from the pump ports before connecting the pipes.
- Flange couplings must always be undertaken by skilled professionals.
- Achieve parallelism between the flanges and observe the maximum tightening torque to prevent tension in the pump casing
- Threaded couplings must always be made by skilled professionals
- Connecting a pump with an internal thread to a pipe with a conical thread can cause the pump casing to burst if the coupling is over-tightened.
- Fit the pump unit with an emergency stop
- Connect and adjust any monitoring and safety systems – controls, manometers, flowmeters, etc. – according to the operating condition for safe operation
- Clean the pump for test oil before operation
- Use suitable safety equipment when aerating the pump such as gloves, protective goggles etc. – depending on the pump liquid
- Never bleed the pump in operation on account of the danger of squirting cold, hot, etching or poisonous liquids under pressure
- The pipe system must be secured against excess pressure in other ways than using the ROTAN bypass valve
- In the event of liquid properties which may block the bypass valve in its function, other comparable devices should be used instead of the ROTAN bypass valve.
- Pumps without a ROTAN bypass valve must use another equivalent safety device which protects pump and motor

- Any change to the pump's max. operating pressure must be followed by a change to the valve's setting - the working pressure must however not exceed the maximum allowable pressure of the pump/valve – see Figure 49.
- Check daily that the max. allowed temperature is observed
- The pump must be shielded when pumping hot liquids that create a surface temperature on the pump of more than +80° C/176°F
A warning sign must be displayed in a clearly visible location!
- When pumping hot liquids, the pipes must be fitted with compensators to prevent tensions in the pump casing
- ROTAN pumps may not be used to pump liquids at a temperature higher than the liquid's ignition temperature, and with reference to the maximum temperatures specified in the table Figure 30 and no higher than the temperature in the table Figure 31 – depending on the type of elastomer used – and for pumps with bypass valve max. 150°C/302°F. The lowest +temperature identified of the four mentioned constitutes the maximum temperature.
- The ED pump may not be used to pump liquids at a temperature that is higher than the liquid's ignition temperature, and with reference to the maximum temperatures specified in the table Figure 30 depending on the magnetic material, and no higher than the temperature stated in the table – Figure 31 – depending on the type of elastomer used - and for pumps with bypass valve max. 150°C/302°F.
The lowest +temperature identified of the four mentioned constitutes the maximum temperature.
The maximum temperature limit identified must be further reduced by the temperature increase generated by the magnets.
- ROTAN pumps are not approved for pumping foods requiring FDA and 3 A – approval
- Use appropriate hearing protection if necessary!
If necessary, display a sign stating that hearing protection must be worn!
- The shaft seal must not be adjusted during operation
- Ball bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F.
- Slide bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F.
- The lubricant for chocolate pumps must not be harmful. The lubricant must be compatible with the chocolate mix
- Observe the safety instructions in the data sheet for the liquid in question and use the specified safety equipment in the form of protective clothing, a breathing mask or similar necessary safety equipment
- Use suitable safety equipment with pump liquids at temperatures of more than +60°C/140°F.
- When pumping hazardous liquids, circulate neutralising liquid before emptying the pump.
- The system must be depressurised before emptying the pump.
- The safety instructions in the data sheet for the liquid in question must be observed, and the safety equipment specified must be used.



3. Safety warnings – electricity

- Electrical couplings must always be established by authorised professionals, in accordance with the prevailing standards and directives.
- Set the protective motor switch
Set the protective motor switch maximum to the motor's rated current



4. Safety warnings – ATEX

- All pump types and pump sizes must always be protected against dry running either by means of a Liquiphant™ or other comparable devices
- Pipe systems after the pump (the pressure side) must be secured with a safety/pressure relief valve which can return the whole liquid quantity to the tank in accordance with the pressure equipment directive 97/23/EC
- If the pump is not protected by the pipe system's safety valve/pressure relief valve or is protected in any other way, a bypass valve must be fitted on the pump
- If the pump is fitted with Rotan bypass valve, a thermal sensor must be fitted to ensure that the pump stops at 80% of the max. allowed surface temperature unless this is secured on other ways.
- Prepare an overall risk assessment in conformity with the current, relevant EC directives on potentially explosive atmosphere in collaboration with the local fire authorities
- The liquid in the heating chambers must have an ignition temperature of at least 50°C above the pump's maximum surface temperature
- Use only instruments and help systems approved by ATEX – such as gears, motors, liquid blocking systems etc. in connection with ROTAN pumps to function in potentially explosive environments
- If you intend to use the pump in a potentially explosive environment, the pump must be connected to an explosion-proof motor
- Use coupling approved by ATEX
- Set the axial clearance to prevent heat generation and the subsequent risk of explosion
- Position and fit vertical pumps in conformity with DESMI's instructions in order to avoid dry running and the subsequent risk of explosion in Ex pumps
- Pump type ED and pumps supplied with a soft stuffing box must always be fitted with a thermal sensor if they are positioned in potentially explosive environments
- Connect the control in conformity with the instructions from the control supplier
- Connect and pre-set the thermal sensor before starting up the pump

- Do not set the control – coupled to the thermal sensor – to a higher temperature than the one specified in the table in Figure 22
- Observe the inspection and maintenance instructions contained in this manual to achieve explosion protection for Ex-labelled pumps.
- Ball bearings must be lubricated to ensure explosion protection.
- Ball bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F – to guarantee explosion protection.
- Ball bearings must be replaced as indicated in Figure 37 to ensure explosion protection
- Slide bearings must be lubricated to guarantee explosion protection.
- Slide bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F – to guarantee explosion protection.
- Use spark-free tools when assembling and dismantling the pump and pump parts in potentially explosive atmospheres
- Pumps must not be used in a potentially explosive environment unless the pump's name plate is labelled EEx II 2GD c X – see the pump's name plate!


5. Pump models

The ROTAN pump has a modular construction, and can be supplied in a large number of models.

The pump's designation is made up of a series of codes which describe various features of the pump.

Below is an example of some of the codes.

Pump versions – see section: "11. Pump versions"

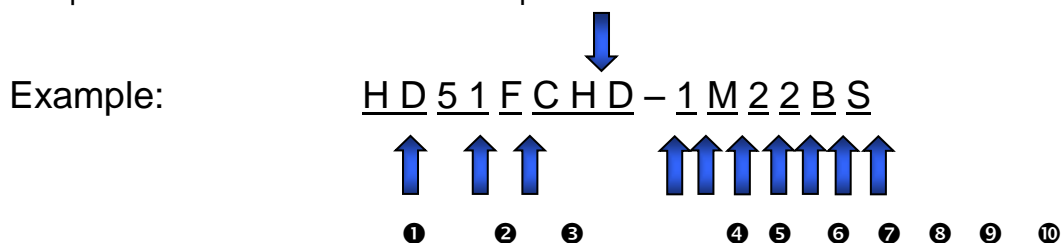

The numbers in the above example refer to the numbers on the next page.

This particular pump's designation is displayed on the pump's name plate – refer to that!

5.1 Pump models

1) Pump types

GP	"General Purpose"	monoblock pump in cast iron
HD	"Heavy Duty"	cast iron pump
PD	"Petrochemical Duty"	steel pump
CD	"Chemical Duty"	stainless steel pump
ED	"Environmental Duty "	pump with magnetic coupling, made of cast iron or stainless steel

2) Pump sizes

26	DN25	- 1"
33	DN32	- 1¼"
41	DN40	- 1½"
51	DN50	- 2"
66	DN65	- 2½"
81	DN80	- 3"
101	DN100	- 4"
126	DN125	- 5"
151	DN150	- 6"
152	DN150	- 6"
201	DN200	- 8"
202	DN200	- 8"

3) Versions

	Coated
E	Straight-through pump
B	Angle pump (not standard)
F	Flange
	Other versions, see next page
R	Bypass valve

4)

-	Hyphen
---	--------

5) Material codes for main parts

<u>Code</u>	<u>Type</u>	<u>Pump casing/Covers</u>	<u>Rotor/St.wheel</u>	<u>Shaft</u>
1	GP/HD	GG-25	GG-25	St.60.2
3	CD	G-X 6 CrNiMo 18 10	X 8 CrNiMo 27 5X8	CrNiMo 27 5
4	PD	GS-52.3	GG-25	St.60.2

All material codes can be used for ED pumps.

6) Lubrication

U	Idler bearing and main bearing lubricated by pump liquid.
M	Externally lubricated idler bearing and main bearing.

7) Material codes for idler bearing

<u>Code</u>	<u>Idler Bush</u>	<u>Idler Pin:GP-HD-PD</u>	<u>Idler pin: CD</u>
1	Cast iron	Hardened 16 MnCr 5	X 8 CrNiMo 27 5
2	Bronze	Hardened 16 MnCr 5	X 8 CrNiMo 27 5
3	Carbon	Hardened 16 MnCr 5	X 8 CrNiMo 27 5
4	Al.oxide	Cr.oxide coated 16 MnCr5	Cr.oxide coated X 8 CrNiMo 27 5
5	Carbon	Al.oxide, polished	Al.oxide, polished
8	Tungsten carbid	Tungsten carbide	Tungsten carbide

8) Material codes for main bearing

<u>Code</u>	<u>Bearing Bush</u>	<u>Shaft: GP-HD-PD</u>	<u>Shaft: CD</u>
1	Cast iron	St.60.2	X 8 CrNiMo 27 5
2	Bronze	St.60.2	X 8 CrNiMo 27 5
3	Carbon	St. 60.2	X 8 CrNiMo 27 5
4	Al.oxide	Cr.oxide coated St.60.2	Cr.oxide coated X 8 CrNiMo 27 5
8	Tungsten carbide		Coated St.60.2 X 8 CrNiMo 27 5
B	Ball bearing	St.60.2	Not available

9) Shaft seal

B	Packing cord, teflon-impregnated
2	Mechanical shaft seal, EN12756-KU, with O-ring or bellows
22	Double mechanical shaft seal, EN12756-KU, O-ring type



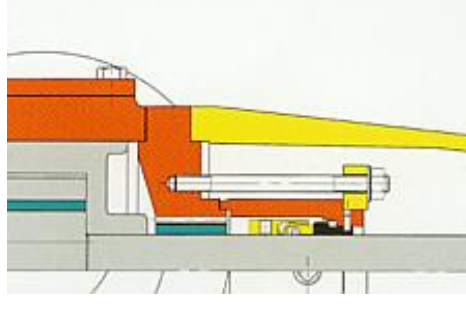
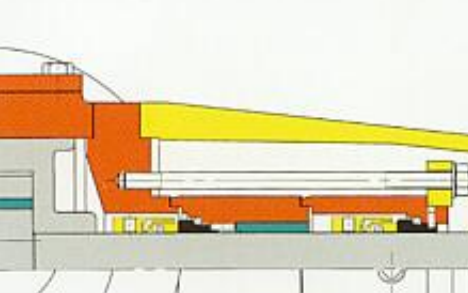
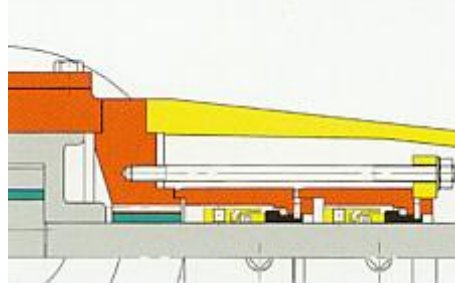
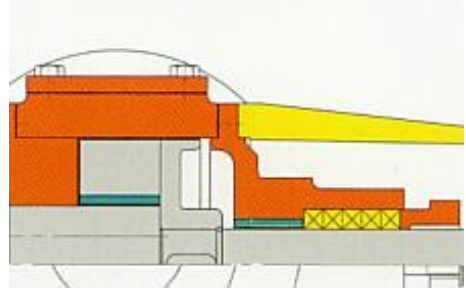
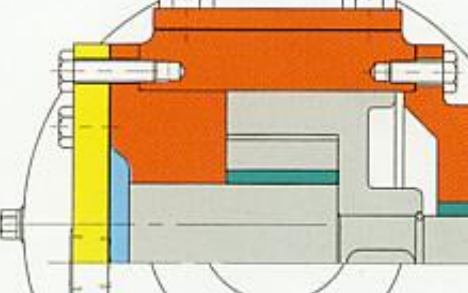
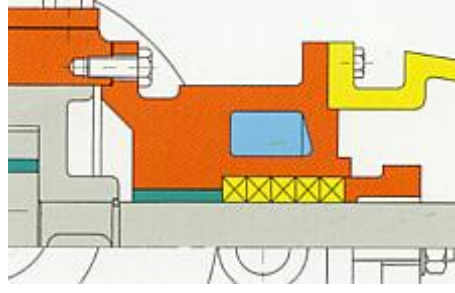
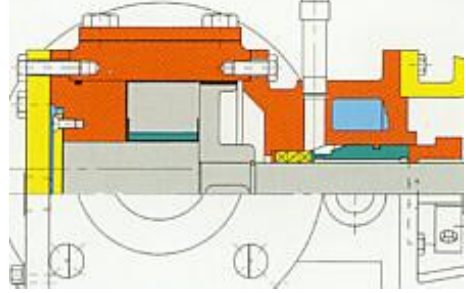
For ED pumps only:

/XX	Magnet length: XX cm.
N	Magnet material: Neodymium-iron-boron
C	Magnet material: Samarium cobalt

10) Special configurations

S	All special configurations are marked with "S"
----------	------------------------------------------------

5.2 Pump versions

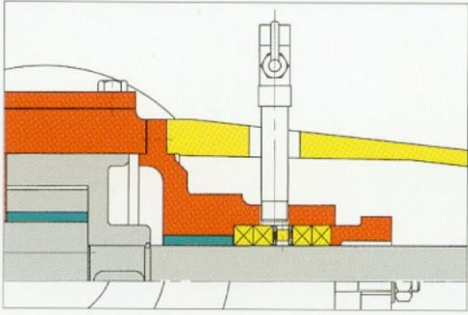		
<p>Sealing with packing coil, with or without lantern ring for external lubrication. Used for liquids with high viscosities and where leaking is allowed.</p>	<p>M – GP/HD Sealing with single mechanical shaft seal, DIN 24960/EN 1275-KU, together with ball bearing as main bearing. Used where only minor leaking can be accepted.</p>	<p>M – PD/CD Sealing with single mechanical shaft seal, DIN 24960/EN 12756-KU, together with media-lubricated slide bearing as main bearing. Used where only minor leaking can be accepted.</p>
		
<p>MM (tandem) - MMP (back to back) Double mechanical shaft seal, DIN 24960/EN 12756-KU, in tandem or back-to-back, with main bearing in the blocking liquid. Used where no leaking is allowed. A differential pressure of up to 6 bar above the pump is allowed.</p>	<p>MMW (tandem) - MMPW (back to back) Double mechanical shaft seal, DIN 24960/EN 12756-KU, in tandem or back-to-back, with main bearing in the liquid. Used where no leaking is allowed. A differential pressure of up to 16 bar above the pump is allowed.</p>	<p>T Special tolerances. Increased tolerances are used for liquids with viscosity above 7500 cSt or at temperature above 150°C.</p>
		
<p>D Heating jackets on front cover is often necessary when pumping highly viscous liquids or liquids that tend to coagulate.</p>	<p>K Heating jacket on the rear cover is often necessary when pumping highly viscous liquids or liquids that tend to coagulate. Can also be used as cooling jacket for shaft sealing.</p>	<p>CHD Combination of special tolerances and heating jackets together with external lubrication of main bearing. Used in the chocolate industry.</p>

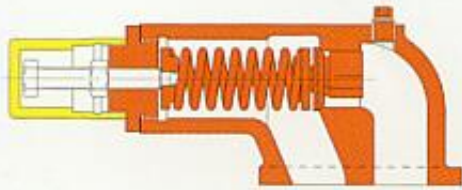
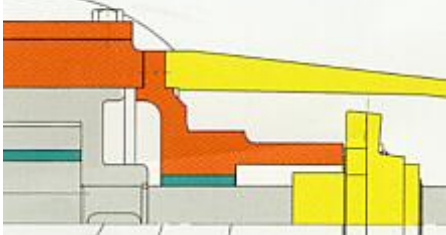
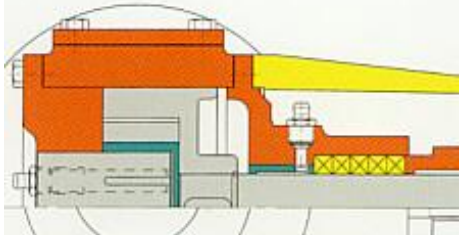
		
<p>R Bypass valve. Single-acting (one direction). Used to protect the pump against brief excess pressures.</p>	<p>S - Special configurations Example: Construction of a cartridge sealing is possible.</p>	<p>Lubrication Externally lubricated idler bearing and main bearing. Used when pumping non-greasing media or media with high viscosity.</p>

Figure 8: The codes of the various pump versions together with an explanation of what they mean.

6 Transporting the pump

The pump must be secured properly on pallets or similar before transport and shipment.

The pump should be transported in such a way that it is not damaged by impacts or blows during transit.

7 Lifting the pump

If the pump's weight is more than the permitted number of kilos/pounds that people may lift in accordance with the prevailing national rules at the location, it must be lifted mechanically.

We refer to the prevailing national rules at the location!

The table below – Figure 9 - shows the weight in kg of the various pump types in the various pump.

Pump weight in kg./lbs. - excl. valve (incl. valve)						
Pump size	Unit	GP/CC	Pump type			
			HD	PD	CD	ED
26	Kg.	11 (13)	5.5 (7.5)	7 (9)	7 (9)	29 (31)
	Lbs.	25 (29)	13 (17)	16 (20)	16 (20)	64 (69)
33	Kg.	12 (14)	6 (8)	10 (12)	10 (12)	30 (32)
	Lbs.	27 (31)	14(18)	22 (27)	22 (27)	67 (71)
41	Kg.	20 (22)	14 (16)	18 (20)	18 (20)	40 (42)
	Lbs.	44 (49)	31 (36)	40 (44)	40 (44)	89 (93)
51	Kg.	50 (56)	35 (41)	36 (42)	36 (42)	90 (96)
	Lbs.	110 (124)	79 (91)	80 (93)	80 (93)	199 (212)
66	Kg.	55 (61)	40 (46)	43 (49)	43 (49)	95 (101)
	Lbs.	122 (135)	89 (102)	95 (108)	95 (108)	210 (223)
81	Kg.	80 (90)	65 (75)	70 (80)	70 (80)	180 (190)
	Lbs.	177 (199)	144 (166)	155 (177)	155 (177)	397 (419)
101	Kg.	105 (115)	90 (100)	96 (106)	96 (106)	200 (210)
	Lbs.	232 (254)	199 (221)	212 (234)	212 (234)	441(463)
126	Kg.	-	140 (160)	152 (172)	152 (172)	350 (370)
	Lbs.	-	309 (353)	336 (380)	336 (380)	772 (816)
151	Kg.	-	190 (210)	205 (225)	205 (225)	400 (420)
	Lbs.	-	419 (463)	452 (496)	452 (496)	882 (926)
152	Kg.	-	280 (340)	335 (395)	335 (395)	-
	Lbs.	-	618 (750)	739 (871)	739 (871)	-
201	Kg.	-	460 (520)	500 (560)	500 (560)	-
	Lbs.	-	1015 (1147)	1103 (1235)	1103 (1235)	-

Figure 9: Table showing the weight in kg of the various pump types in the various pump sizes.

Weights are excl. valve – the figures in brackets are incl. valve.

Weights are excl. motor/gear and base frame (if any).



Lift the pump mechanically, if the pump's weight is more than the permitted number of kilos that people may lift.



Do not place fingers in the pump's ports when lifting or handling the pump.





Motors fitted with lifting eyes must be used to lift the whole pump, but only to lifting the motor separately.

Lift of the pump should be performed in stable suspension points so that the pump is balanced and the lifting straps are not placed over sharp edges



Lift of the pump shall be performed in conformity with the lifting instructions in Figure 10 – Figure 12

Lifting instructions for pumps	
Pump with free shaft end / with flange	Pump with free shaft end / with thread
<p>Figure 10: Lifting instructions for pump with free shaft end with flange. Attach 2 shackles to the flanges on the pump for lifting straps. The shackles must be placed in the flanges at the pump's centre of gravity.</p>	<p>Figure 11 Lifting instructions for pump with free shaft end with thread.</p>
Pump type GP with thread	Pump type GP with flange
<p>Figure 12: Lifting instructions for GP pump type with thread.</p>	<p>Figure 13: Lifting instructions for GP pump type with flange.</p>

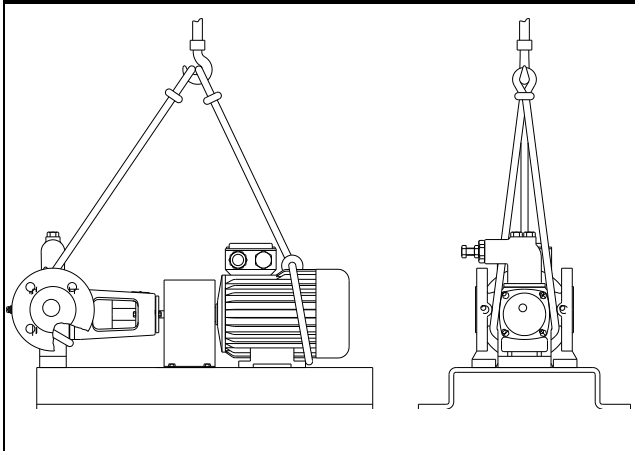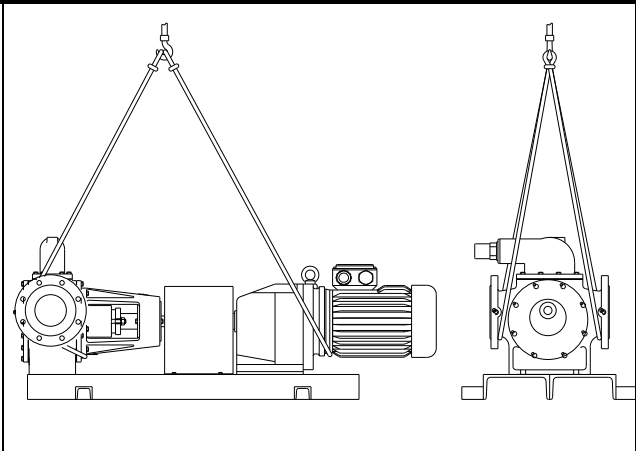Pump with motor	Pump with gear motor
	
<p>Figure 14: Lifting instructions for pump with motor.</p>	<p>Figure 15: Lifting instructions for pump with gear motor.</p>

8 Storage, long-term preservation and frost protection of the pump

Rotan pumps are protected against corrosion at the factory.

The pumps are preserved internally using oil, and pumps for the food industry are preserved using vegetable oil.

External, non-stainless surfaces are covered with primer and protective paint – except the shaft. Flanges and pipe couplings are closed using plastic plugs.

This protection will last for approximately six months, on the condition that the pump is stored indoors in a dry, dust-free, non-aggressive atmosphere.

8.1 Storage

When stored for a longer period of time, the pump must be inspected after no more than six months – depending on the storage conditions. The pump shaft must however be turned manually approx. every 4 weeks to avoid standstill damages to bearings and seals.

Avoid storage:

- in an environment containing chloride
- on foundations with continuous vibrations as the bearings may be damaged
- in unventilated rooms

Recommended storage:

- indoors in a dry, dust-free, non-aggressive atmosphere
- in well-ventilated rooms to prevent condensation
- flanges and pipe couplings using plastic plugs
- pump packed if necessary in plastic film with moisture-absorbing Silica Gel bags

8.2 Preservation procedure

Make sure that the pump does not corrode or dry out, as drying out between the sliding surfaces of the bearings can cause them to become damaged when the pump is put into operation.

Preservation of the pump is necessary on untreated surfaces – both external and internal. Rustproof surfaces do not require any special protection.

1. If the pump has been in operation it must be emptied – see section entitled: “Emptying and cleaning the pump”!
2. Rinse the pump with clean, hot water, then empty it and dry it. The pump must not be left with damp surfaces on the inside.
3. Spray on an anti-corrosion oil, such as: Q8 Ravel D/EX, Mobilarma 777 or equivalent. Alternatively, it is also possible to use acid-free oil, such as hydraulic oil. Pumps fitted with EPDM rubber seals do not tolerate mineral oil-based oils and certain food oils. As an alternative, in this instance you can use silicon oil or a fire-resistant type of polyglycol-based hydraulic oil. Pumps for the food industry are preserved with vegetable oil. This can be applied by spraying in through both the inlet and outlet ports – if necessary by means of compressed air.
4. For pumps intended for integration in an existing pipe system, the anti-corrosion oil can be sprayed in through the manometer holes in the inlet and outlet ports, or through the bore that has been provided to connect a manometer.
5. Fill the pump with sufficient oil for the oil to start running out of the pump.
6. Then rotate the pump shaft manually so that all internal surfaces are lubricated.
7. This process must be repeated every six months.
8. In addition, the pump shaft should be rotated about 1/1 turn every month during the whole preservation period
9. If the pump is to be stores outside the pipe system, pipe plugs should be fitted on the pump ports during the whole preservation period

8.3 Frost protection

Pumps that are out of operation during periods of frost must be emptied of liquid to avoid frost damage. You can use anti-frost liquids, but you must make sure that the elastomers used in the pump will not be damaged by the liquid used.

9 Installation

All items in this section must be read and observed when installing ROTAN pumps.

9.1 Selecting the motor etc.

All instruments and help systems used in connection with the ROTAN pump in potentially explosive environments such as gears, motors and blocking liquid systems etc. should all be approved by ATEX.



Use only instruments and help systems approved by ATEX – such as gears, motors, liquid blocking systems etc. in connection with ROTAN pumps to function in potentially explosive environments

The flange motor in and GP pumps must have a locked bearing at the end of the shaft end – as well as vertically positioned pumps, to ensure that the pump's axial clearance falls within permitted parameters.

CC pump must have a angle bearing in non drive end and wave springs in drive end

9.2 Connecting the motor and the pump



If you intend to use the pump in a potentially explosive environment, the pump must be connected to an explosion-proof motor/gear



Use coupling approved by ATEX



Carefully shield the coupling between the pump and motor

1. Before connecting the motor and the pump, check that the pump shaft can revolve easily and regularly.
2. When connecting the motor with the pump, you must make sure that the pump shaft and the motor shaft are on precisely the same centre line and that there are a few mm between the shaft ends
3. Pump types HD, CD, PD and ED must be connected to the motor by means of an elastic coupling.

4. If a ROTAN standard coupling is used, the pump and the motor are aligned as described in the following section.
Other couplings are fitted and aligned in accordance with the coupling supplier's instructions – refer to these!

9.3 Aligning the motor and the pump

If a ROTAN standard coupling is used, the motor and the pump are aligned as follows. Other couplings are aligned in accordance with the coupling supplier's instructions with regard to the maximum permitted tolerances for eccentricity and non-parallelism.

1. Check the centring between the pump shaft and the motor shaft by means of a straightedge. Place the straightedge over the two coupling pieces 2-3 places on the circumference – 90° apart. Any misalignment will become evident in the form of a gap of light between the straightedge and the coupling hub.
2. Centring may deviate by a maximum of 0.05 mm/0.002 inches when both halves of the coupling rotate.
3. Check the parallelism/gap between the halves of the coupling, using an air gap gauge. The gap may be a maximum of 0.5° – or when both halves rotate the gap deviation may not exceed 0.05 mm/0.002 inches on the same point.
4. Alignment is corrected by inserting suitable intermediate layer of material between the pump's or the motor's base and base frame.

Insufficient alignment between pump and motor causes increased wear on the coupling elements.

9.4 Axial clearance



Set the axial clearance to prevent heat generation and the subsequent risk of explosion

After coupling and alignment between motor and pump has been completed, the pump's axial clearance must be set correctly, see section entitled: "Setting the axial clearance".

The axial clearance does not have to be set for pumps purchased with a motor, as this is set in the factory.

9.5 Horizontal/vertical positioning of the pump

The standard position is for the pump to be horizontal to the foundation, i.e. with a horizontal pump shaft and the valve/blank flange on top and the suction port along. Normally other positions are not recommended.

In special cases the ROTAN pump may however be placed horizontally with the suction port upwards or downwards, or the pump could be placed vertically, but only if it is designed especially for this purpose and the instructions below are observed.

9.5.1 Horizontal positioning of the pump



Position and fit horizontal pumps required to be positioned with the suction port upwards or downwards as described below to avoid dry running and the subsequent risk of explosion in Ex pumps

If the pump is positioned with the suction port upwards or downwards instead of horizontally, a water trap must be used – see Figure 16.. The water trap must be used to ensure that the pump does not lose the sealing liquid and in this way its priming ability and to prevent dry running as dry running is not allowed – see section 11. 8 – Dry running

In this context water trap is defined as an "S"-shaped duct run – see Figure 16 or an "U"-shaped duct run – see Figure 17. When using a water trap, the pump must be placed at the lowest point in the pipe system, so that it retains its priming ability – dry running is not permitted. In addition, ensure that the system's liquid container on the suction side does not run dry.

The top point of the water trap – see point A, Figure 16 - must be above the level of the pump. Point A must be at a higher level than the uppermost flange of the pump to ensure that the pump is full of liquid. If point A is not above the level of the pump, the function of the water trap will be abolished.

The pump "housing" itself can be located on the side where it is most expedient.

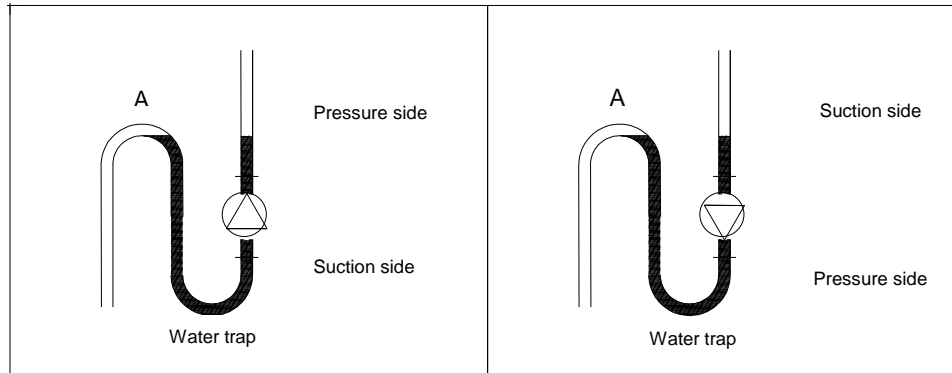


Figure 16: Shows a simplified sketch of a pump (the circle) fitted in a water trap. The pump is fitted so that the shaft is horizontal. Point “A” shows the top point of the water trap which must be above the upper flange of the pump.

9.5.2 Vertical positioning of the pump



The ROTAN pump may only be positioned vertically if it has been produced especially for this purpose at the factory.



Position and fit vertical pumps as described below, to avoid dry running and the subsequent risk of explosion in Ex pumps.

A ROTAN pump should as a rule *not* be positioned vertically, i.e. with a vertical pump shaft and the motor on top. A pump may only be positioned vertically if it has been produced *especially* for this purpose at the factory.

In the event of vertical positioning of the pump, it must be placed at the lowest point in the pipe system so that it retains its priming ability as dry running is not permitted – see section 11.8 – Dry running


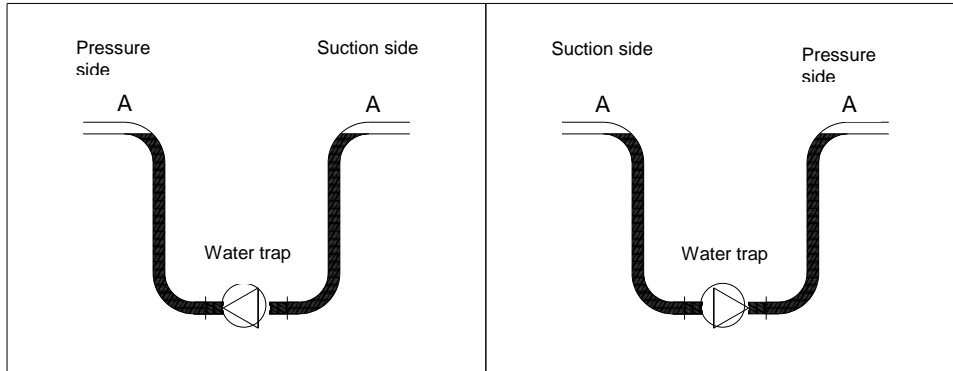


Figure 17: Shows a simplified sketch of a pump (the circle) fitted in a water trap. The pump is fitted so that the shaft is vertical. Point "A" shows the top point of the water trap which must be higher up than the pump.

9.6 Positioning of the pump on foundation

There must, to the extent possible, be plenty of room around the pump to allow for repairs and maintenance.

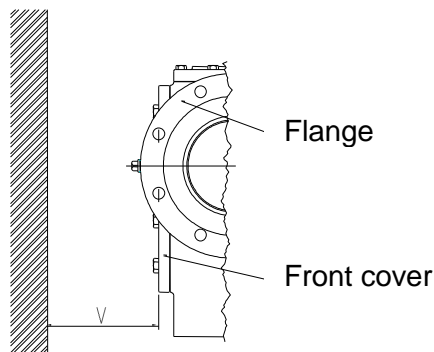

Distance between pump and wall											
Pump size	26	33	41	51	66	81	101	126	151	152	201
V-dist. in mm	50	60	65	70	80	100	115	140	165	180	215
V-dist. in inches	2	2.4	2.6	2.8	3.2	4	4.6	5.6	6.5	7.1	8.5

Figure 18: The minimum distance to the wall – WV-dist. in mm – to enable removal of the front cover. The table shows the size of the W-dist. for the various pump types. This distance must be observed for both horizontally and vertically positioned pumps.

The pump must be placed on a sturdy, vibration-free foundation with a level surface and bolted firmly to the foundation.

If the surface is not level, compensation must be made for this using a suitable intermediate layer so that preloads are avoided.

Bolt the pump securely to the foundation.

You must also take into account the pump's suction lift – see section entitled: "Suction lift" under "Technical specifications".

If the pump has a soft shaft seal, a drainage pipe must be connected to the bracket's drainage hole.

Vertical pumps are bolted securely to an existing wall or a vertically cast foundation. The minimum distance between front cover and floor appears from Figure 18.

9.7 Before connecting the pipes

In order that the pump is able to draw, it must be filled with liquid before it is started. Before the pipes are fitted, the pump is filled with a volume of liquid that enables the liquid to start running out of the pump.

Vertically positioned pumps are filled with liquid after the pipes are connected.



Clean out any impurities from the pipe system before the pump is connected to it



Remove the protective plugs from the pump ports before connecting the pipes.

The pump must be installed so that there is no tension between the pipe and the pump casing. The permitted loads on the pump flanges are described in the following section: "External loads on pump flanges".

9.7.1 External loads on pump flanges

There must be no tensions between the pipe and the pump casing when the pump is installed. Tension in the pump casing as a result of preloaded pipes will create a significant increase in the rate of wear.

Pipes and wires must be supported as close to the pump casing as possible.

The diagram below shows the maximum permitted external force and torque that can be applied to the pump flanges.

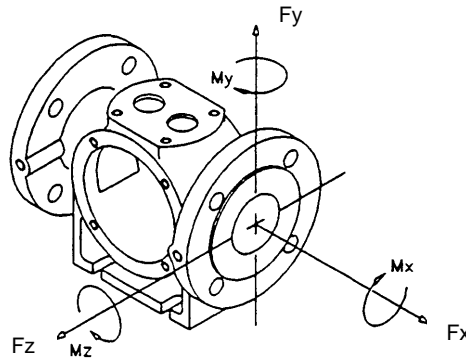


Figure 19: The location of forces and torque on the pump casing.

Maximum external force and torque loads								
Pump size	Force				Torque			
	$F_{(x,y,z)}$ N	$F_{(x,y,z)}$ Lbf	$F_{(Total)}$ N	$F_{(Total)}$ Lbf	$M_{(x,y,z)}$ Nm	$M_{(x,y,z)}$ Lbfft	$M_{(Total)}$ Nm	$M_{(Total)}$ Lbfft
26	190	42.7	270	60.7	85	62.7	125	92.2
33	220	49.5	310	69.7	100	73.8	145	106.9
41	255	57.3	360	80.9	115	84.8	170	125.4
51	295	66.3	420	94.4	145	106.9	210	154.9
66	360	80.9	510	114.7	175	129.1	260	191.8
81	425	95.5	600	134.9	215	158.6	315	232.3
101	505	113.5	720	161.9	260	191.8	385	284
126	610	137.1	870	195.6	325	239.7	480	354
151 / 152	720	161.9	1020	229.3	385	284	565	416.7
201	930	209.1	1320	296.7	500	368.8	735	542.1

Figure 20: The maximum permitted external forces and torque that may be applied to pump flanges for the various pump sizes. x, y and z appear from Figure 19: The location of forces and torque the pump casing.

The forces F (Total) in N/Lbf and torque M (Total) in Nm/Lbfft are calculated as follows:

$$F_{(total)} = \sqrt{F_x^2 + F_y^2 + F_z^2}$$

$$M_{(total)} = \sqrt{M_x^2 + M_y^2 + M_z^2}$$

- on the condition that the x, y and z components cannot all have the maximum value at the same time.

If the maximum permitted force and torque loads specified cannot be observed, compensators must be built into the pipe system.

When pumping hot liquids, the pipes must always be fitted with compensators so that the pipes and the pump are able to expand.

If a ROTAN pump with belt drive is required, the permitted power on the outlet shaft is provided on request.

9.7.2 Flange coupling



Flange couplings must always be undertaken by skilled professionals.



Achieve parallelism between the flanges and observe the maximum tightening torque to prevent tension in the pump casing

1. Before connecting the flange, check that the flanges are parallel, as any variance in parallelism will create tension in the pump casing. Parallelism is achieved by aligning the pipe system or fitting compensators.
 2. Select the bolt size for the flanges on the basis of the pump size in the table in Figure 21. You should not use bolts with a yield stress of more than 240 N/mm², corresponding to quality 4.6 – for pumps manufactured in grey cast iron, material code “1”.
 3. Find the maximum tightening torque in the table in Figure 21. Please note that the table contains the maximum tightening torque. The necessary tightening torque depends on: packing, form, material and the pump liquid's temperature. The values in column A are valid for pumps manufactured in grey cast iron – material code “1”. The values in column B are valid for pumps manufactured in steel – material codes “3” or “4”.
3. Cross-tighten the bolts using the uniform tightening torque shown in the table below.

Bolt size/maximum tightening torque					
Pump size	Bolt*	Maximum tightening torque			
		A Nm	A Lbfft	B Nm	B Lbfft
26	M12	30	22.1	80	59
33-126	M16	75	55.3	200	147.5
151-201	M20	145	106.9	385	284

Figure 21: The bolt sizes available for connecting flanges, together with the maximum tightening torque depending on the pump size and material stated.

Column A contains the maximum tightening torque for pumps manufactured in grey cast iron – material code “1”.
Column B contains the maximum tightening torque for pumps manufactured in steel – material codes “3” or “4”.

*You should not use bolts with a yield stress of more than 240 N/mm², corresponding to quality 4.6, for pumps manufactured in grey cast iron – material code “1”.

9.7.3 Threaded coupling



Threaded couplings must always be made by skilled professionals



Connecting a pump with an internal thread to a pipe with a conical thread can cause the pump casing to burst if the coupling is over-tightened.

We recommend that you connect pumps with an internal thread to pipes with a cylindrical thread.

9.8 Dry running

The pump should be secured against dry running as otherwise it will result in unnecessary wear or destruction. Dry running results in heat development and potential spark formation at pump casing, bearings and shaft sealings.

Pump supplied for potentially explosive environments must therefore always be secured against dry running as otherwise there is a risk of explosion on account of overheating and spark formation.

Pumps for potentially explosive environments must be secured against dry running either by means of fitting a Liquiphant™ or other comparable devices with at least the same safety effect. The Liquiphant™ should be fitted to the inlet pipe according to the manufacturer's installation instructions.

The Liquiphant™ may normally be used for liquids up to 10,000 cSt and a pressure up to 64 bar. However, the manufacturer's technical data shall apply if they deviate from what is mentioned. See the supplier's technical data!

For pumps used for pumping of liquids with a higher viscosity and/or operating under a higher pressure than mentioned – such as pump types HD, PD, CD – another device comparable to the Liquiphant™ should be used. Dry running may for example be secured in the pipe construction, at the inlet on the suction side of the pump so that it is ensured that there is always liquid in the pump, and at the same time it may be secured that the system's liquid tank on the suction side does not run dry for liquid.



All pump types and pump sizes must always be protected against dry running either by means of a Liquiphant™ or other comparable devices

9.9 Thermal sensor

Pump type ED and pumps supplied with a soft stuffing box must always be fitted with a thermal sensor if the pump is designed for use in a potentially explosive environment. The sensor is fitted to secure that the pump's max. allowed surface temperature is not exceeded during operation.



Pump type ED and pumps supplied with a soft stuffing box must always be fitted with a thermal sensor if they are installed in a potentially explosive environment.

Pumps not designed for potentially explosive environments are only supplied with thermal sensor according to customer requests.

When installing the pump, the thermal sensor must always be connected to a control, and the control must be connected before starting to use the pump. The control is to be connected in conformity with the supplier's instructions.



Connect the control in conformity with the supplier's instructions

The thermal sensor must always be connected to the control, and the control must be set according to the temperature class for which the pump is approved and according to the environment in which the pump is to operate. It appears from the ATEX labelling on the pump's name plate for which environment and which temperature class the pump is approved. See the pump's name plate!



Connect the thermal sensor to the control, and set it before starting up the pump

The table below shows which temperature the control should be set to on the basis of the temperature class and whether it is an environment containing gas or dust.

Setting of control for thermal sensor		
T-class	Gas	Dust
T1 (450°C/842°F)	360°C/680°F	300°C/572°F
T2 (300°C/572°F)	240°C/464°F	200°C/392°F
T3 (200°C/392°F)	160°C/320°F	133°C/271.4°F
T4 (135°C/275°F)	108°C/226.4°F	90°C/194°F
T5 (100°C/212°F)	80°C/176°F	66°C/150.8°F
T6 (85°C/185°F)	68°C/154.4°F	56°C/132.8°F

Figure 22: The table shows which temperature the control should be set to on the basis of the determined T-class – which appears from the name plate – and if it is environment containing gas or dust.

The control connected to the thermal sensor must not be set to a temperature exceeding the one stated in the table – Figure 22.



Do not set the control – connected to the thermal sensor – to a temperature exceeding what is stated in the table in Figure 22

It, however, it is deemed necessary to set the control to a higher temperature than indicated in the table, special approval has to be obtained from DESMI A/S, and a separate, unique assessment should be prepared. As a customer, you should also be able to present documentation that no sparks are formed in the area in question in the event a deviation is requested from the temperatures prescribed in the table. The documentation is to be submitted to DESMI A/S, and together with DESMI's assessment/approval it will be submitted for filing with an approved, authorised authority!

9.10 Emergency stop



Fit the pump unit with an emergency stop

If the pump is fitted as part of a total system, this must be provided with an emergency stop. The emergency stop is not included in DESMI's delivery.

When installing the pump, the emergency stop must be:

- Designed, set up and installed, and function in accordance with the prevailing standards and directives
- Positioned within easy reach, so that it is accessible to the operator/engineer during repairs, adjustment and maintenance of the pump
- Be tested regularly to check that it is in full working order

9.11 Electrical coupling



Electrical couplings must always be established by authorised professionals, in accordance with the prevailing standards and directives



Set the protective motor switch
Set the protective motor switch maximum to the motor's rated current.

When installing the pump, check:

- That the local mains voltage is the same as stated on the motor's name plate.
- That the motor's direction of rotation corresponds with the desired pump direction.
When the pump unit is viewed from the motor end, and you require the pump direction to the left, the motor's rotation must be clockwise

9.12 Monitoring



Connect any monitoring and safety systems that are necessary for safe operation



Connect and adjust any monitoring and safety systems – manometers, flowmeters, etc. – according to the operating condition

10 Before starting the pump

The pumps are tested and preserved with oil type GOYA 680 transmission oil (Q8) with a viscosity of about 70 cSt. Pumps in versions "CHD" and "EPDM" are preserved in the factory using vegetable oil. The pump is emptied for oil, but it has not been cleaned for test oil from the factory.

The pump must be cleaned for test oil before starting up the pump if the test oil is not compatible with the pump liquid. In each individual case it is to be estimated the degree of cleaning which is deemed necessary. The cleaning should be of such a magnitude that no damage to humans, animals, materials or pump liquid occurs.



Clean the pump for test oil before start-up

Before starting the pump, check:

- That the pump shaft can be turned around freely
- That the pump is connected to an explosion-proof motor, if the pump is set up in a potentially explosive atmosphere
That the pump's and the motor's name plates are labelled with explosion protection
- That the pump and motor are aligned precisely – see section entitled: "Alignment between motor and pump"
- That the bearings – if they have lubrication nipples – are lubricated
- That the ball bearings' maximum service life is observed
- That the thread of the thermal sensor has not broken off during transportation, handling or installation – if the pump is fitted with thermal sensor (applies to ATEX pumps)
- That the thermal sensor is connected – if the pump is fitted with thermal sensor
- That all isolating valves in the suction and pressure pipe are fully open, to avoid the pressure being too high and the pump running dry
- That any by-pass valve is fitted correctly – see section entitled: "Positioning of valve"
- That any bypass valve is adjusted to the correct opening pressure – see section entitled: "Setting of bypass valve"
- That the pump casing is filled with liquid to ensure the ability to self-prime – see section entitled: "Before connecting the pipes"
- That there is no coagulated liquid in the pump or the pipe system – after the last operation – that may cause blockage or breakdown
- That the necessary monitoring and safety systems are connected and adjusted according to the operating conditions/instructions in this manual

10.1 Before starting after preservation

If the pump has been in storage for a long period of time, you must also check the following:

Before starting - after preservation - check:	
<ul style="list-style-type: none">• That the pump is not corroded or dried out – see section entitled – see section entitled: “Storage and protection of pump”. Check that the pump shaft rotates freely	
<ul style="list-style-type: none">• That any preservative or anti-frost liquid is cleaned off before starting the pump – if these are not compatible with the pump liquid	
<ul style="list-style-type: none">• That elastomers are replaced if they have been damaged by the anti-frost liquid used	
<ul style="list-style-type: none">• That ball bearings and any elastomers are replaced if the pump has been in storage for more than 6 years, as the lubricating grease used for elastomers and ball bearings has a limited service life	

11 After starting the pump

ROTAN pumps may only run without liquid flow for the short period required for self-priming – with regard to the slide bearings and shaft seals.

After starting the pump, check:
• That the pump is drawing the liquid
• That there is no cavitation in the pump casing
• That the speed is correct.
• That the direction of rotation is correct. Viewed from the motor side, liquid is pumped to the left when the shaft rotates clockwise.
• That the pump is not vibrating or emitting a jarring sound
• That the stuffing box and bearings are not becoming hot. If the pump has been fitted with lip seals, these will normally cause the shaft to heat up during the ring's running-in period, which lasts approx. 2 hours.
• That there are no leaks by the pump
• That the mechanical shaft seal is fully sealed Stuffing boxes with packing rings may, however, permitted a low level of leakage – 10-100 drops of leakage per minute – see section entitled: "Adjustment of soft shaft seal"
• That the operating pressure is correct
• That the by-pass valve opens at the correct pressure
• That the pressure in the heating jacket does not exceed 10 bar/145 psi. – if the pump has one
• That the magnetic clutch (type ED) is not slipping and thus causing an inadequate flow, and that the temperature in the magnetic clutch does not exceed the permissible value
• That the power consumption is correct
• That all monitoring equipment is in full working order
• That any pressurised water pipes, heating/cooling systems and lubricating systems, etc. are operating and in full working order
• Running in the soft shaft seal – see section entitled: "Running in the soft shaft seal"

11.1 Cavitation

There must be no cavitation in the pump casing as this results in extensive damage to the pump. The cause of cavitation should be found and the problem solved.

Cavitation is defined as formation and deflation of steam-filled bubbles. This process may exist in areas within the pump where the pressure falls to a level below the steam pressure of the liquid. Always ensure that there is adequate pressure at the pump inlet to avoid cavitation so that the liquid does not boil or evaporate. Always check that the pump suction pressure is greater than the liquid's steam pressure irrespective of the temperature.

Cavitation can be ascertained in the form of vibrations and jarring sound from the pump. It may sound as if gravel was running through the pump. Cavitation arises when the vacuum in the pipe on the suction side is too high.

The increased vacuum may be caused by the following:

- That any filters in front of the pump are blocked or too narrow
- That the liquid viscosity is too high
- That the suction pipe is too long
- That the suction pipe is too narrow

Check if any filters fitted in front of the pump are blocked. If so, clean the filter thoroughly. If there is feed flow to the pump, you should bleed the pump before starting again. If there is no feed flow to the pump, the pump should be filled with liquid before start-up to avoid dry running as no dry running is allowed – see section 11.8 - Dry running.

If this does not solve the problem, you should check some of the other options.

If cavitation is due to too high viscosity, the problem may be remedied by fitting a suction pipe with a larger diameter or by heating the pump liquid so to increase the fluidity of the liquid and in this way a lower viscosity.

If cavitation is due to the suction pipe being too long, this may be remedied by moving the pump closer to the tank from which the pump is drawing or by fitting a suction pipe with a larger diameter.

After this, bleed the pump of fill in liquid before starting again.

Bleed the pump by turning the screw on top of the bypass valve fitted on the pump. Bleeding of the pump is completed when excess liquid flows out above.

Never bleed the pump in operation on account of the danger of squirting cold, hot, etching or poisonous liquids under pressure.



Use suitable safety equipment when bleeding the pump– such as gloves, protective goggles etc. – depending on the pump liquid



Never bleed the pump in operation on account of the danger of squirting cold, hot, etching or poisonous liquids under pressure

If the pump is not fitted with a valve, you may bleed the pump casing by removing the blank flange on top of the pump.

11.2 Running in the soft shaft seal – when starting the pump



A soft shaft seal may only be used on pumps in potentially explosive environments if the soft shaft seal is equipped with thermal sensors to control the temperature.

When starting a new pump, the shaft seal must be run in as described below:

1. Once the pump has started, the shaft seal must leak more than 200 drops per minute to saturate the rings.
2. When the shaft seal is saturated – after approx. 30 minutes' operation – the packing gland screws must be tightened gradually, so that the leakage is reduced.
3. Check that the gland does not become hot.
If the gland becomes hot, loosen the packing rings slightly, after which you must check that the temperature is falling.
4. When the leakage is between 10 – 100 drops per minute, do not tighten the screws any more.
The number of drops per minute depends on the pump size, pressure and speed.
5. The gland must not be tightened so much that there is no leakage.
The soft shaft seal must leak continuously.
6. The leakage rate must be checked at regular intervals, see section entitled "Maintenance"

If necessary, see also the section entitled: "Adjustment of soft shaft seal"

12 Bypass valve

The section below uses both the designations *bypass valve* and *safety valve*.

Safety valve is defined as a valve fitted on the pressure pipe in the pipe system and which secures the whole pipe system in the event of constant pressure increase. The safety valve has return flow to the liquid tank.

Bypass valve is defined as the valve supplied by DESMI A/S and which is fitted on the ROTAN pump – see Figure 25. The bypass valve secures only pump and motor. The bypass valve does not secure the whole pipe system. The bypass valve protects pumps in the event of brief pulsating excess pressures and not in the event of constant pressure increase. The function of the valve is described in detail under the section: 14.3 Operating principle - valve.

ROTAN pumps are supplied both *with* and *without* a bypass valve.



The bypass valve is not approved for protection of the pipe system, and therefore it must not be used for this purpose.



The pipe system must be protected against excess pressure in other ways than by use of the ROTAN bypass valve.

If a pipe system contains a facility to block the pump's pressure line, the pressure line must be fitted with a bypass valve to take the full liquid volume - as pumping up against a blocked outlet line causes rapid pressure increase and results in heat accumulation inside the pump. This heat accumulation inside the pump is transferred to the pump surface and therefore constitutes a risk of explosion as for pumps functioning in a potentially explosive environment.



If the possibility exists to block the pump's pressure line, the pressure line must be fitted with a bypass valve to take the full liquid volume - as otherwise there is a risk of explosion

The ROTAN bypass valve must not be used for constant pressure control – such as "keep-pressure valve".

If a need for constant pressure control exists, another solution should be found leading to the same result - such as frequency converter or gear.



Do not use the valve for constant pressure control – such as "keep-pressure valve"



The liquid volume may not circulate through the bypass valve for a long period of time. Circulation over a long period of time through the bypass valve causes a significant heating up of the pump and pump liquid, and this may result in destruction of the pump



The liquid volume may not circulate through the bypass valve for a long period of time. Circulation over a long period of time through the bypass valve causes a significant heating up of the pump and pump liquid, and this can create a risk of explosion.



Fit equipment preventing against bypass.

The ROTAN bypass valve is also supplied as a double-action bypass valve.

If there is a need to pump in both directions, the pump may be fitted with a double-action bypass valve.



If there is a need to pump in both directions, fit a double-action bypass valve.

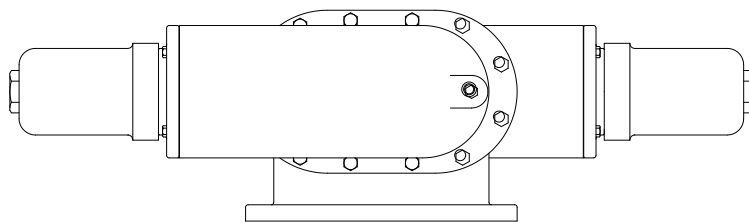


Figure 23: A double-action bypass valve.

Please note that certain liquids' properties or heated liquids may block the bypass valve's function, e.g. paint, chocolate, asphalt, etc.

Blocking of the valve may be caused by the liquid containing particles or the liquid being heated and subsequently coagulating in connection with bypass in the valve.

In such cases it is recommended not to use a ROTAN bypass valve, but another device instead.

If liquids possess properties which may block the bypass valve and prevent it from working, you must use another equivalent device rather than a ROTAN by-pass valve.

However, in some cases a special ROTAN bypass valve can be supplied with heating jacket for connection to heating to prevent coagulation of the liquid – see Figure 24.

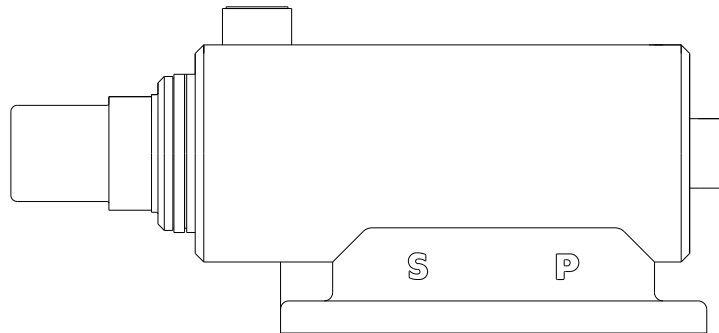


Figure 24: A ROTAN bypass valve with heating jacket for connection to heating

If you wish to have the pump supplied without a ROTAN bypass valve, another equivalent safety device must be used, so that you can still ensure that the pump cannot generate a pressure that is higher than the maximum specified when placing the order and the max. pressure which appears from Figure 49..



Pumps without a ROTAN bypass valve must use another equivalent safety device which protects pump and motor.

If a pump is supplied without a ROTAN bypass valve, it will be fitted with a blind cover.


A ROTAN bypass valve is always provided with a bore for connection of manometer. The bore is covered by a pipe plug.

12.1 Valve configurations

For pumping liquids at high temperatures, the valve can be supplied with a heating jacket. The heating jacket prevents the pump liquid from coagulating when passing through the valve.

12.2 Positioning the valve

The bypass valve is fitted with an inlet and an outlet. The inlet and outlet are named as follows:

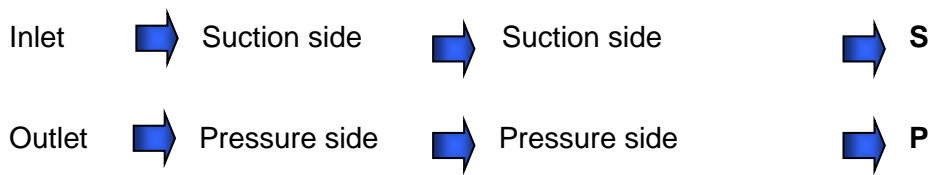

The suction side and pressure side are indicated on the valve by the letters **S** and **P** – see figure 5.

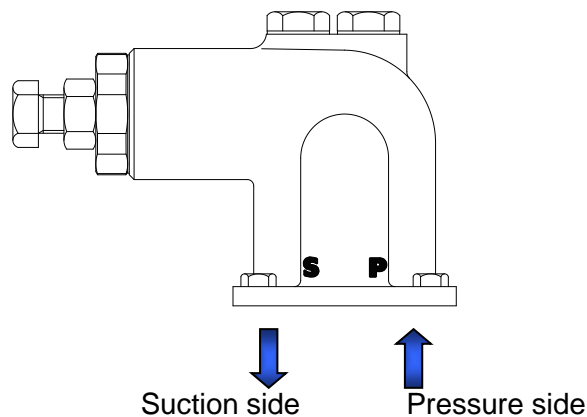


Figure 25: Shows how **S** for suction side and **P** for pressure side are indicated on the valve.

If the pump has been bought with a valve, it is always fitted to the pump in the factory.

Before the pump is installed in a pipe system, the valve must be positioned correctly with regard to the desired direction of circulation, as incorrect positioning of the valve will stop it from working.

The valve's **S** inlet must be placed by the pump's suction side, so that the regulating screw points towards the suction side.



Position the valve correctly, with **S** over the inlet/suction side and **P** over the outlet/pressure side.

12.3 Operating principle – valve

When the pressure increases in the pump, the pump liquid is forced into the valve's pressure side – **P**.

If the valve's preset pressure is exceeded, the internal spring is depressed, after which the pump liquid is forced out of the outlet side of the valve and down into the pump again.

In this way recirculation of the pump liquid is created.

This recirculation may not last for a long period of time, as this will cause the liquid and the pump to heat up significantly.



The pump must not pump with the valve open for a long period of time.



Recirculation through the bypass valve over a long period of time causes the liquid and the pump to heat up significantly



Recirculation through the bypass valve over a long period of time can destroy the pump.

12.4 Setting the by-pass valve

The by-pass valve is set by adjusting the regulating screw which is located on the end of the valve, see figure 26.

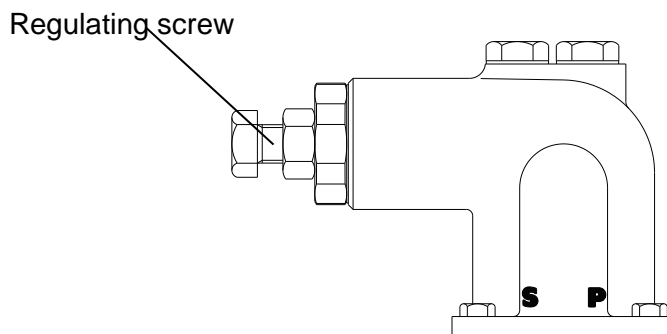


Figure 26: The location of the regulating screw on the ROTAN bypass valve.

The bypass valve is always set at the factory.
The valve is set in accordance with either

- customer instructions
- or DESMI's default setting

If the valve has been set in accordance with customer instructions, this setting must correspond with the other instructions prescribed in this user manual, in the section entitled "Bypass valve".

If the setting is DESMI's default setting, this has been made on the basis of the tables – Figure 28 or Figure 29. Figure 28 covers valves fitted with a *non-stainless key* and Figure 29 covers valves fitted with a *stainless key*.

It appears from the pump designation on the pump's name plate if the valve is supplied with a stainless or non-stainless key.

Example

Pump designation: HD/PD/GP/ED 26-201 - "1U..." + "4U..."

Non-stainless key

Pump designation: CD/ED 26-201 - "3U..."

Stainless key

All settings of the regulating screw must be made on the basis of the tables – Figure 28 – or Figure 29 – or by means of pressure gauge.

As a default, the valve is always set to an operating pressure of 8 bar from the factory.

The default setting of the valve has been made as follows:

1. The valve has a number, and this number can be read on the pump's name plate
2. The obtained valve number is found in the table Figure 28 or Figure 29
3. If the valve number obtained cannot be found in the table, go in under pump type and pump size at the extreme left in the table Figure 28 or Figure 29
4. Pump type and pump size can be read on the pump's name plate
5. It appears from the pump designation on the pump's name plate if the valve is supplied with a stainless or non-stainless spring – see above! Use figure 22 for non-stainless keys and figure 23 for stainless keys
6. Next to the valve number or pump type/pump size there are several different setting measurements. The A-value corresponding to 8 bar/116 psi. in the table is selected.

Example

HD26/Valve no.: **8300** (*non-stainless key*) Operating pressure: 8 bar/116 psi.

A-value = 23.9 mm/,94inches.

In the case of valves that have been set in accordance with customer instructions, you can identify the operating pressure to which the valve has been set as follows:

The operating pressure to which the valve has been set:

1. The valve has a number, and this number can be read on the pump's name plate
2. The obtained valve number is found in the table Figure 28 (non-stainless key) or Figure 29 (stainless key)
3. If the valve number obtained cannot be found in the table, go in under pump type and pump size at the extreme left in the table Figure 28 or Figure 29
4. Pump type and pump size can be read on the pump's name plate
5. Measure the valve's setting value as shown in Figure 27.
6. The value can be seen in the table on the basis of the valve number obtained, and the operating pressure is read off according to this

Example:

HD26 / Valve no.: 8300 (non-stainless key) ➡ A-value: 22.9 mm/0,90inches

➡ Operating pressure = 8 bar/116 psi.

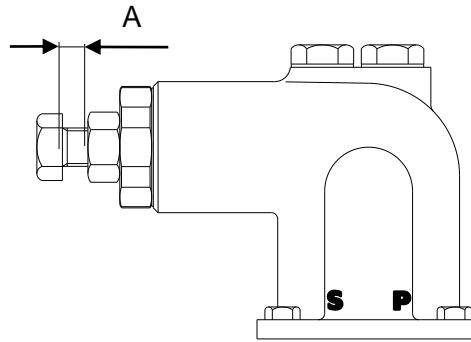


Figure 27: The setting value “A” for ROTAN valves.

Valve settings												
Type HD / GP / PD / ED (non-stainless)												
Operating pressure in bar/psi												
		bar:	2	4	6	8	10	12	14	16		
		psi:	29	58	87	116	145	174	203	232		
Pump type	Pump size	Valve no.	A-setting Spring not ten- sioned	Setting value A in <u>mm.</u>								
PD/HD/ GP/ED	26/33/41	6686, 6687 6688, 6691 6692	27,2	26,6	25,7	24,7	23,9	23,0	22,2	21,3	20,3	
	51/66	6693, 6695	31,8	31,4	31,2	30,4	28,8	27,5	26,7	25,3	23,6	
	81/101	6696, 6698	34,5	33,1	31,6	30,2	28,7	27,3	25,7	24,7	23,2	
	126/151	6699, 6701	46	44,4	42,0	40,4	38,3	36,1				
	152/201	6702, 6704	63,3	62,1	59,6	57,6	55,3	53,7				
Setting value A in <u>inches</u>												
PD/HD/ GP/ED	26/33/41	6686, 6687 6688, 6691 6692	1,07	1,05	1,01	0,97	0,94	0,91	0,87	0,84	0,8	
	51/66	6693, 6695	1,25	1,24	1,23	1,2	1,13	1,08	1,05	1,0	0,93	
	81/101	6696, 6698	1,36	1,30	1,24	1,19	1,13	1,07	1,01	0,97	0,91	
	126/151	6699, 6701	1,81	1,75	1,65	1,59	1,51	1,42				
	152/201	6702, 6704	2,49	2,44	2,35	2,27	2,18	2,11				

Figure 28: Setting value “A” in mm/inches, based on the valve number or on pump type/pump size and the valve’s operating pressure in bar. The shaded field indicates that the pump sizes 101 +126 + 151 + 152 + 201 cannot operate with an operating pressure exceeding 10 bar/145 psi. – see figure 44.
The table applies to valves fitted with a non-stainless key.

Valve settings											
Type CD / ED (stainless)											
Operating pressure in bar/psi											
		bar:	2	4	6	8	10	12	14	16	
		psi:	29	58	87	116	145	174	203	232	
Pump type	Pump size	Valve no.	A-setting Spring not ten- sioned	Setting value A in mm.							
				CD/ED	26/33/41	6689, 6690	26,1	25,7	24,8	23,8	22,9
51/66	6694	32	31,5		31,2	30,2	28,4	27,3	26,2	24,8	23,3
81/101	6697	34,55	33,5		31,7	30,2	28,7	26,9	25,2	23,6	21,9
126/151	6700	45,6	43,6		41,3	38,9	36,9	34,6			
152/201	6703	62,3	60,4		57,9	55,6	52,4	50			
Setting value A in inches											
CD/ED	26/33/41	6689, 6690	1,03	1,01	0,98	0,94	0,90	0,87	0,83	0,79	0,76
	51/66	6694	1,26	1,24	1,23	1,19	1,12	1,07	1,03	0,98	0,92
	81/101	6697	1,36	1,32	1,25	1,19	1,13	1,06	0,99	0,93	0,86
	126/151	6700	1,8	1,72	1,63	1,53	1,45	1,36			
	152/201	6703	2,45	2,38	2,28	2,19	2,06	1,97			

Figure 29: Setting value "A" in mm/inches, based on valve number or pump type/pump size and the valve's operating pressure in bar. The table applies to valves fitted with a stainless spring.



Any change to the pump's operating pressure must be followed by a change to the valve's setting - the working pressure must however not exceed the maximum allowable pressure of the pump/valve - see Figure 49

If the valve is not reset, this will mean either

- that the valve's safety function fails so that there is a risk of pressure accumulation
- or that the valve remains open permanently, creating a significant heating up of the pump and pump liquid – which must **not** last for a long period of time



The liquid volume may **not** circulate through the bypass valve for a long period of time

Circulation over a long period of time through the bypass valve causes a significant heating up of the pump and pump liquid, and this can create a risk of explosion



The liquid volume may **not** circulate through the bypass valve for a long period of time. Recirculation through the bypass valve over a long period of time can cause destruction of the pump.



Never set or adjust the bypass valve in operation on account of the danger of squirting cold, hot, etching or poisonous liquids under pressure



Whenever the valve is set or readjusted, the regulating screw **must** be repacked with thread tape.

13 Pump liquids

13.1 Hot liquids

When pumping hot liquids at high temperatures, suitable procedures must be drawn up to prevent any danger of injury caused by touching or standing close to the pump.



Check daily that the max. allowed temperature is observed



The pump must be shielded when pumping hot liquids that create a surface temperature on the pump of more than +80°C/176°F
A warning sign must be displayed in a clearly visible location!



When pumping hot liquids, the pipes must be fitted with compensators to prevent tensions in the pump casing

There are various maximum temperatures for ROTAN pumps, depending on the pump type and the type of elastomer used, see Figure 19 – Figure 31.



ROTAN pumps may not be used to pump liquids at a temperature that is higher than the liquid's ignition temperature, and with reference to the maximum temperatures specified in the table in the table below – Figure 20 - depending on the type of elastomer used - and for pumps with bypass valve max. 150°C/302°F.

The lowest +temperature identified of the four mentioned above constitutes the maximum temperature.

The maximum liquid temperature for ED pumps also depends on the magnetic material used, see Figure 19.

The temperature of the liquid also increases during operation, through the heat generated by the magnets, depending on the liquid's flow rate and viscosity.

The temperature increases up to 30°C/86°F.



The ED pump may not be used to pump liquids at a temperature that is higher than the liquid's ignition temperature, and with reference to the maximum temperatures specified in the table in Figure 30 depending on the magnetic material, and no higher than the temperature stated in the table below – Figure 31 – depending on the type of elastomer used – and for pumps with bypass valve max. 150°C/302°F.

The lowest +temperature identified of the four mentioned above constitutes the maximum temperature.

The maximum temperature limit identified must be further reduced by the temperature increase generated by the magnets.

Max. liquid temperature	
Pump type	Temperature °C / °F
GP	Max. 150°C/302°F
HD/PD/CD*	Max. 250°C/482°F
ED	Max. 130°C/266°F (Magnetic material: Neodym-Iron-Bor)
	Max. 250°C/482°F (Magnetic material: Samarium – Cobalt)
CC	Max. 80°C/176°F

Figure 30: The pump liquid's maximum permitted temperature for the various pump types.

For pumps with a bypass valve the temperature is limited to a maximum of 150°C/302°F due to the valve spring. However, the valve can be supplied with a different key, enabling the pump's temperature range to be fully utilised. The ED pump's maximum temperature depends on factors such as the magnetic material.

* Pump types HD, CD og PD – designed with special tolerances – may in certain cases be use dup to 300° C/572°F.

Minimum/maximum elastomer temperature			
Elastomer type	Elastomer brand	Temperature in °C	Temperature in °F
FPM	Viton®	Approx. -25°C/+170°C*	Approx. -13°F/+338°F*
FEP	Teflon® with Viton core	Approx. -60°C/+205°C	Approx. -76°F/+401°F
EPDM	Ethylene-propylene	Approx. -65°C/+120°C	Approx. -85°F/+248°F
FFKM	Kalrez®	Approx. -50°C/+316°C	Approx. -58°F/+600°F
NBR	Nitril	Approx. -30°C/+70°C	Approx. -22°F/+158°F
PTFE	Teflon	Approx. -15°C/+170°C	Approx. -5°F/+338°F

Figure 31: The pump liquid's minimum/maximum temperature limits for the various elastomers used in ROTAN pumps.



Extra shielding may be purchased from DESMI

13.2 Foods



ROTAN pumps must not be used to pump foods requiring FDA or 3A approval.

14. Noise

The noise level of ROTAN pumps depends on various parameters.

The different parameters that can influence the sound pressure level are: differential pressure, viscosity, installation conditions, pump size and flow.

The curves shown in Figure 32 denote standard units with ROTAN pumps' A-weighted sound pressure levels, in relation to pump size and flow.

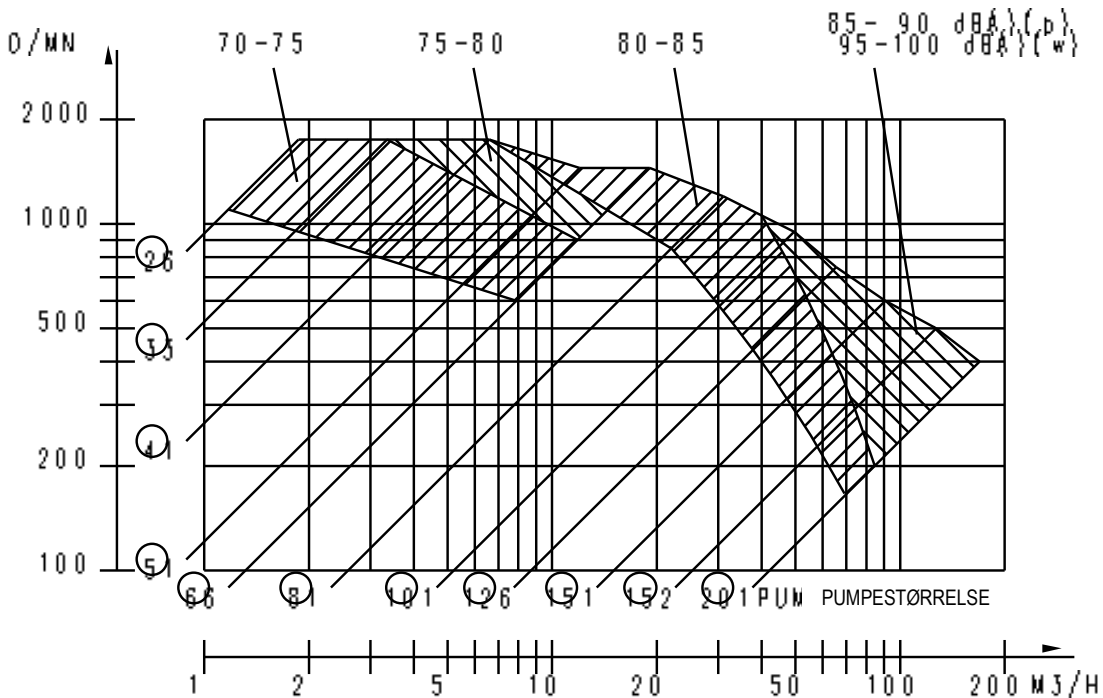


Figure 32: The maximum A-weighted sound pressure level in dB(A)(Lp) for the various pump sizes in relation to the pumps' flow. The range above 85 dB(A) is also expressed as sound power level (Lw).

The sound pressure curves shown are measured at a distance of 1 metre from the pump's surface and at a height of 1.60 metres above the floor. The dB(A) curves shown are calculated on the basis of measurements taken when pumping mineral oil with a viscosity of 75 cSt at a differential pressure of 5 bar/72 psi. The curves are based on normal industrial use, and not on laboratory conditions.

If people are working by the pump, we refer to the prevailing local national laws and regulations on noise limits at the workplace.

We refer to the prevailing local national laws and regulations on noise limits at the workplace.

Appropriate noise reduction measures must be implemented in accordance with the aforementioned local national laws and regulations, if so required.



Use appropriate hearing protection if necessary!
If necessary, display a sign stating that hearing protection must be worn!

14 Storing the user manual

This user manual must be retained throughout the pump's full service life, and must always accompany the pump.

The user manual must be available to operators, repair engineers and any maintenance staff or other people who may be considered to have a need to refer to it.

The user manual must also be stored visible, in the immediate vicinity of the pump. If this is not possible, there must be a prominent sign by the pump stating where the user manual is kept.

It is also recommended that a copy of the user manual is stored somewhere else.

If people who are expected to have a need to refer to the user manual are of a different linguistic origin than the language in which the user manual has been legally supplied, it is recommended that the user manual is translated into the language in question.

15 Maintenance

The pump must be inspected and maintained on an ongoing basis in accordance with the schedule below – Figure 33.

Compliance with regular maintenance in accordance with the schedule below is particularly important for explosion-proof pumps (ATEX), as inspection and maintenance of the pump constitutes a part of the explosion protection.



Observe the inspection and maintenance instructions contained in this manual to achieve explosion protection for Ex-labelled pumps.

Maintenance	
During daily inspection, check:	Solution:
That the pump does not vibrate or emit jarring sounds	
That there is no cavitation inside the pump casing	
That lubricated slide bearings are lubricated	
That open ball bearings are lubricated	
That there is liquid in connection with liquid-greased slide bearing	
That any lubricating devices are in working order	
That any circulation pipes – cooling, heating or pressurised water pipes are in working order	
That power output and power consumption are correct	
That flow and operational pressure is correct	
That the max. allowed temperature is observed	
During weekly inspection, check:	
That any filters and drainage holes are clean	
That the soft stuffing box is leaking 10-100 drops per minute	
That mechanical shaft seals are not leaking	
That the surroundings of the stuffing box and bearings are free from dirt	
Whether flexible connecting elements are worn	To be replaced if worn
During inspection every 2 months, check:	
That the bearings do not have too much play	
That the bypass valve, if any, functions correctly and opens at the right pressure	
That the stuffing box is intact	To be after-packed or repacked
DESMI Ltd.	
In connection with service work, check:	
All parts for wear and tear	Replace worn parts
That all parts are located correctly in connection with assembly	

Figure 33: The figure shows which parts or what must be checked and maintained on the pump, and at what intervals this must be undertaken.

16.1 Adjusting the soft shaft seal



The shaft seal must not be adjusted during operation

It is important that the soft shaft seal leaks during operation, as this provides lubrication and also releases the frictional heat that is generated.

The shaft seal with packing coil requires continuous adjustment, to make sure that the volume of leakage by the stuffing box is correct.

Depending on the speed, pressure, pump size and viscosity, the stuffing box must leak 10-100 drops per minute to remove the frictional heat that is generated between the shaft and the packing rings. If there is insufficient leakage, the heat generated can cause the gasket rings to harden and create increased wear on the shaft.

The leakage described above is achieved by tightening the packing rings axially, so that they apply a pressure against the shaft. This pressure restricts the flow of the liquid, as the play between the shaft and the packing ring is in the order of a few thousandths of a millimetre. Soft shaft seal

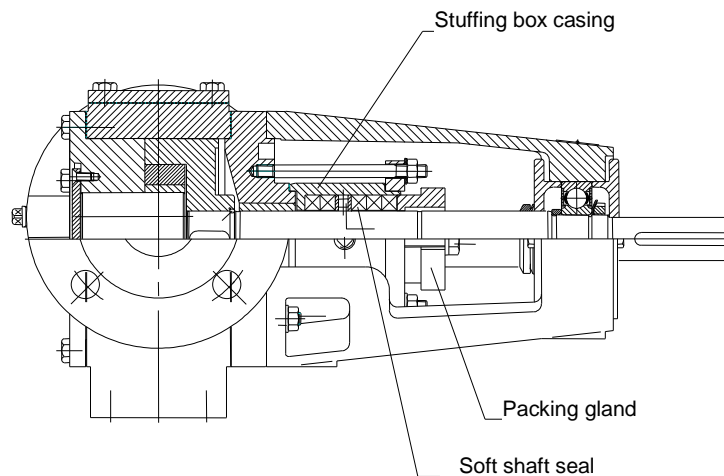


Figure 34: The location of the soft shaft seal, the shaft seal casing and the packing gland on the pump. The design of the shaft seal casing, does, however, depend on the individual pump application.

16.1.1. Repacking – soft shaft seal

1. Pull the packing gland back on the shaft once the screws have been removed.
2. The packing rings can now be pulled out using a packing extractor.
3. Check the shaft and the shaft seal housing thoroughly for wear, scratches and deposits.
4. Replace worn parts and remove deposits with care.
5. Always conduct a control measurement of the shaft and the shaft seal housing before specifying the packing dimension.

!! Never use old packing rings when measuring

The packing dimension is defined on the basis of the following:

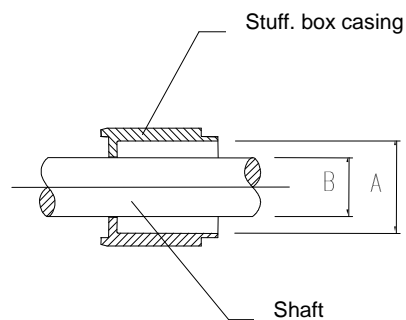


Figure 35: The A and B dimensions on the shaft and the shaft seal housing

The A and B dimensions obtained are inserted in the following formula to determine the packing dimension.

$$\frac{A - B}{2} = \text{packing dimensioning}$$

6. New packing rings are bought as spare parts or produced as described in step 7.
7. Trim the new packing rings on the shaft or a mandrel of the same diameter as the shaft.
Wrap the packing around the shaft/mandrel the number of times that packing rings are to be used, and cut through with a sharp knife.
8. If the packing rings are difficult to move into position, they can be rolled with a pipe or similar item.
Never strike a gasket, as the fibres in the material will be destroyed and the sealing property will be significantly worsened.

9. Lubricate the individual rings with a little oil to facilitate installation.
10. Turn the ring openings so that the two rings lying alongside one another are diametrically offset.
11. Finally, tighten the packing gland gently by hand, and restart the pump.

16.2 Ball bearings

The pump is fitted with a ball bearing – pos. CU – at the pump's free shaft end.

Some pumps are fitted with two ball bearings – pos. CU + BC – see the position numbers on the spare part drawings.

ED pumps are fitted with two ball bearings – pos. NB – on pumps with a free shaft end.

All bearings are model 63 deep-groove ball bearings, fitted with two rubber seal rings, no seal rings or one single seal ring.

16.2.1 Lubrication of ball bearings



Ball bearings must be lubricated to ensure explosion protection



Ball bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F – to guarantee explosion protection.



Ball bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F.

Ball bearings with two seal rings do not require re-lubrication, as they are filled with a suitable amount of grease in the factory.

Ball bearings with *one single* seal ring or *no* seal ring require re-lubrication via the lubrication nipple.

If the ball bearings require lubrication, they are fitted with a lubrication nipple.

The bearings must be lubricated at the lubrication intervals and using the volume of grease as stated in the table in Figure 36.

The re-lubrication interval is halved for every 15°C/59°F that the temperature exceeds 70°C/158°F.

Service life of ball bearings in ROTAN pumps @ 1000 cSt				
Pump type	Pump size	Ball bearing type	Min. service life in hours at 70°C	Max. operating pressure
GP HD PD CD	26 / 33	6302 2RS1	10,000 hours	16 bar/232 psi.
		6304 2RS1	27,000 hours	16 bar/232 psi.
	41	6304 2RS1	12,000 hours	16 bar/232 psi.
		6305 2RS1	18,000 hours	16 bar/232 psi.
	51 / 66	6306 2RS1	8,000 hours	16 bar/232 psi.
		6307 2RS1	8,000 hours	16 bar/232 psi.
	81	6308 2RS1	7,000 hours	16 bar/232 psi.
		6310 2RS1	9,000 hours	16 bar/232 psi.
	101	6308 2RS1	25,000 hours	10 bar/145 psi.
		6310 2RS1	36,000 hours	10 bar/145 psi.
	126	6310 2RS1	30,000 hours	10 bar/145 psi.
		6312 2RS1	32,000 hours	10 bar/145 psi.
	151	6310 2RS1	12,000 hours	10 bar/145 psi.
		6312 2RS1	11,000 hours	10 bar/145 psi.
	152	6310 2RS1	4,000 hours	10 bar/145 psi.
		6314 2RS1	5,000 hours	10 bar/145 psi.
		6312 2RS1	9,000 hours	10 bar/145 psi.
	201	6315 2RS1	8,000 hours	10 bar/145 psi.

Figure 37: Ball bearing types and the minimum service life in hours for the various pump types and sizes. The service life is calculated on the basis of a temperature of 70°C/158°F and a viscosity of 1000 cSt., and based on the maximum operating pressure of the various pump types. The bearings' service life is reduced at temperatures above 70°C/158°F and in ATEX pumps – see section above.

Service life of ball bearings in ROTAN high-pressure pumps @ 1000 cSt				
Pump type	Pump size	Ball bearing type	Min. service life in hours at 70°C	Max. operating pressure
GP	27 / 34	6304 2RS1	12,000 hours	25 bar/362,5 psi.
	42	6305 2RS1	13,000 hours	25 bar/362,5 psi.
	52 / 67	6307 2RS1	8,000 hours	25 bar/363,5 psi.
	82	6310 2RS1	8,000 hours	25 bar/363,5 psi.

Figure 38: Ball bearing types and the minimum service life in hours for pump type GP in the sizes indicated. The service life is calculated on the basis of a temperature of 70°C/158°F and a viscosity of 1000 cSt., and based on the maximum operating pressure of ROTAN high-pressure pumps. The bearings' service life is reduced at temperatures above 70°C/158°F and in ATEX pumps – see above.

16.3 Lubrication of slide bearings



Slide bearings must be lubricated to guarantee explosion protection



Slide bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F – to guarantee explosion protection



Slide bearings must be lubricated with heat-resistant grease when pumping liquids over 100°C/212°F

The ROTAN pump is designed with an idler bearing and a main bearing.

The idler bearing is a slide bearing, and the main bearing can be either a slide bearing or a ball bearing.

The table below shows what the various pump types are equipped with. The position numbers refer to the section entitled “Spare parts drawings”.

<u>Type HD:</u>	Idler bearing* pos. AD/main bearing pos. BC Main bearing = slide bearing at soft shaft seal Main bearing = ball bearing at mechanical shaft seal
<u>Type CD, PD:</u>	Idler bearing* pos. AD/main bearing pos. BC Main bearing = slide bearing
<u>Type GP:</u>	Idler bearing* pos. AD/main bearing pos. BC Main bearing = slide bearing at soft shaft seal Main bearing = ball bearing at mechanical shaft seal
<u>Type ED:</u>	Idler bearing* pos. AD/main bearing pos. BC Main bearing = slide bearing
<u>Type CC:</u>	Idler bearing pos. AD Main bearing = none

* The idler bearing is, however, not fitted to pump sizes 26 + 33, where the idler is made of bronze or cast iron. The idler is instead fitted with a plate, so that the idler/idler pin can be lubricated.

The pump can be supplied with internal or external lubrication. If the pump liquid itself has a lubricating effect or is of sufficiently high viscosity, the bearings are lubricated by the pump liquid – otherwise the bearings must be lubricated via the lubrication nipple.

If the pump is supplied with an idler bearing and a main bearing for external lubrication, the pump designation will include an “M” – see the pump’s name plate! – if not, there is a “U” in the place indicated.

Example: HD51BDK-1**M**22BS = External lubrication
 HD51BDK-1**U**22BS = Internal lubrication

The bearings must be lubricated in accordance with the table in Figure 39, but the relubrication intervals and grease volumes are only guidelines, as the re-lubrication interval in particular is largely dependant on the conditions. Contact the supplier for correct guidance!

The bearings must be lubricated with a grease type suitable for the liquid and liquid temperature. Contact the supplier for selection of the correct grease type!

In connection with chocolate pumps – pump version “CHD” – a vegetable fat type must be used which is compatible with the chocolate mass so that no harmful substances are transferred to the chocolate. Contact the supplier for selection of the correct grease type!



”CHD” pumps with lubrication connection in the back cover must not be pressure-lubricated with more than 20 bar/290 psi.



The lubricant for chocolate pumps must not be harmful. The lubricant must be compatible with the chocolate mass

Lubrication of slide bearings					
Pumpe type: HD, GP, CD, PD, ED, CC	Re-lubrication interval in hours	Amount of grease in grams		Amount of grease in ounce	
		Main bearing (grams)	Idler bearing (grams)	Main bearing (ounce)	Idler bearing (ounce)
26	8 hours	1	1	0.04	0.04
33		1	1	0.04	0.04
41		1	1	0.04	0.04
51		1.5	1.5	0.05	0.05
66		1.5	1.5	0.05	0.05
81		2	2	0.07	0.07
101		2	2.5	0.07	0.09
126		2.5	4	0.09	0.14
151		2.5	6	0.09	0.21
152		4	10	0.14	0.35
201		8	14	0.28	0.49

Figure 39: Re-lubrication intervals and amounts of grease in grams for lubrication of slide bearings – main bearing and idler bearing.

17 Troubleshooting

Problem:								
8. Lack of co-ordination between pressure and capacity								
7. The pump cannot self-prime								
6. The pump loses liquid after self-priming								
5. The capacity is too low								
4. The pump is making a noise								
3. The motor is overloaded								
2. The pump has jammed								
1. The pump wears quickly								
Cause:	1	2	3	4	5	6	7	8
1. Too great a vacuum				X	X	X	X	
2. Cavitation				X	X	X		
3. Viscosity too high			X	X	X		X	X
4. Temperature too high		X	X				X	
5. The pump is drawing air				X	X	X	X	X
6. Pressure too high	X	X	X		X			
7. Defective valve			X	X	X			
8. The pump is corroded	X				X		X	
9. The pump is worn					X		X	
10. Impurities in the pump	X	X	X					
11. The stuffing box is over-tightened*	X		X					
12. Fault in the motor			X					
13. Pipe too constricted or blocked					X		X	
14. Wrong speed							X	
15. The pump runs without liquid	X	X					X	
16. Liquid temp. too high – lack of lubricant	X	X						
17. Speed too low					X			
18. Speed too high				X				X
19. Suction line not dipped in liquid							X	
20. Liquid being fed above liquid level				X				
21. Valve incorrectly adjusted					X			
22. The pump's shaft end is bent	X			X				
23. Coupling incorrectly aligned	X			X				
24. Pump twisted in relation to pipe system	X	X	X	X				
25. Leaking pipes/assemblies							X	

Figure 40: Various problems that can arise and possible causes of the problems.

*Point 11 does not apply for pump type ED.

Because of the ROTAN pump's large number of possible combinations and the many pump liquids used, it is not possible to provide instructions on the rectification of the problems in this manual.

If the pump has been bought in Denmark, we therefore refer to DESMI's service centres at the back of this manual. If the pump was bought outside Denmark, we refer to the relevant distributor.

18 Emptying and cleaning the pump

If the liquid being pumped is inflammable, toxic, corrosive or hazardous in any other way, or if the liquid has a temperature of more than 60°C/140°F, special safety measures must be implemented before the pump is emptied.

The liquid's safety data sheet must be obtained and read before emptying the pump.

Please refer to the relevant liquid's safety data sheet.



Observe the safety instructions in the data sheet for the liquid in question and use the specified safety equipment in the form of protective clothing, a breathing mask or similar necessary safety equipment



Use suitable safety equipment with pump liquids at temperatures of more than +60°C/140°F



When pumping hazardous liquids, circulate neutralising liquid before emptying the pump



The system must be depressurised before emptying the pump.



Use spark-free tools when removing the front cover/dismantling the pump in potentially explosive atmospheres



1. When pumping hazardous liquids, circulate a liquid that has a neutralising effect in relation to the pump liquid.
We recommend the use of thin neutralising liquids to facilitate drainage.
2. Empty the pipe system.
Note that there is still liquid in the bottom of the pump casing and in the shaft seal housing, even if the pipe system is empty, and in the case of the ED pump there will also be liquid in the magnetic coupling's canister.
3. Stop the unit

4. Close the valves on the suction side and the pressure side, if the system is equipped with these, so that the system is depressurised.
5. Place a collecting tank under the pump to take the volume of liquid contained in the part of the system to be emptied.
6. Remove the front cover and the heating jacket
7. Remove the pump and place it with the ports pointing up/down, and then rotate the shaft manually to empty

Please note that the drainage time is longer for highly-viscous liquids, as these find it difficult to make their way from the stuffing box house through the chamber between the rotor and the rear cover to the pump casing.

Some special versions of the pump are fitted with one or more draining plugs, to facilitate the drainage of highly-viscous liquids.

19 Disposal of liquid

The safety data sheet for the liquid used must be obtained, and the liquid must be disposed of in accordance with the safety data sheet's instructions.

Please refer to the relevant liquid's safety data sheet!



The safety instructions in the data sheet for the liquid in question must be observed, and the safety equipment specified must be used.

20 Repairs



Use spark-free tools when assembling and dismantling the pump and pump parts in potentially explosive atmospheres.

Pumps that are sent to DESMI for repair must have been emptied and cleaned before our factory can accept them, and the pumps must be accompanied by information about the pump liquid used.

Cleaning and emptying of the pump must be undertaken with due regard to the safety of our repair engineers.

We would point out that certain liquids coagulate and harden before arrival at our factory, which makes any repairs fully or partly impossible if the pump has not been emptied and cleaned before shipment.

In such cases, inadequate emptying and cleaning will generate increased repair costs, or in the worst case mean that the pump has to be scrapped.

ROTAN pumps must be emptied and cleaned in accordance with the instructions in the section “Emptying and cleaning the pump” – see this!

20.1 Reinstallation of thermal sensor

If the thermal sensor has been dismantled during repair work, the sensor must be reinstalled.

1. Check that the sensor is intact
2. Apply heat-conducting paste to the tip of the sensor in order to secure good heat transmission
3. Check that the thermal sensor is fitted correctly – see installation instructions for the thermal sensor
4. Control/see to it that the thermal sensor is connected to the control
5. Control/see to it that the control is connected
6. Check that the thermal sensor/control functions correctly.



Remember to connect the thermal sensor to the control and reconnect the control again after finishing repairs

20.2 Axial clearance

The axial clearance is the distance between the rotor/idler and the front cover.

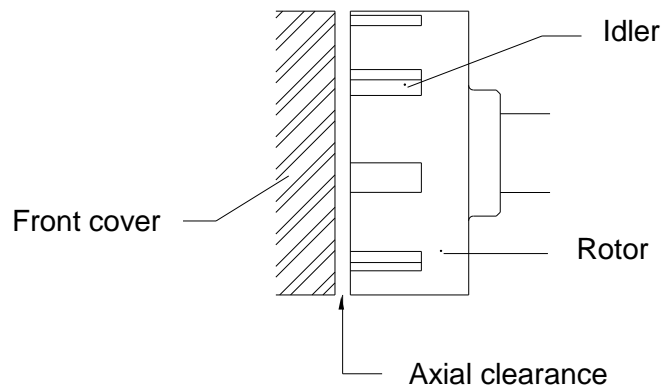


Figure 41: The axial clearance between the rotor/idler and the front cover.

The axial clearance is set in the factory in accordance with the section entitled “Setting of axial clearance”.

The axial clearance must be reset after the pump has been repaired or if the pump is worn.

There are various ways of setting the axial clearance, depending on the pump type and whether or not the pump is installed in a pipe system. See the section entitled: “Setting of axial clearance”.

20.1.1 Checking the axial clearance

The axial clearance can be checked as described below:

Non-installed pump:

The pump's axial clearance can be checked with an air gap gauge which is passed in through one of the pump's ports between the rotor/idler and the front cover.

The axial clearance identified must correspond to the values in the table in Figure 42.

Installed pump:

The axial clearance cannot be checked when the pump is installed in a pipe system.

The play must therefore be reset as described in the section entitled: "Setting of axial clearance".

Axial clearance in mm/inches									
Pump size	Unit		26/33	41	51/ 66	81/ 101	126/ 151	152	201
Normal axial clearance*	mm.	Min.	0.10	0.10	0.15	0.20	0.30	0.35	0.40
		Max.	0.125	0.15	0.20	0.25	0.375	0.45	0.50
Pumps with spec. tolerances**		Min.	0.20	0.20	0.30	0.40	0.60	0.70	0.80
		Max.	0.25	0.30	0.40	0.50	0.75	0.90	1.0
Normal axial clearance*	inches	Min.	0.0039	0.0039	0.0059	0.0079	0.0118	0.0138	0.0157
		Max.	0.0049	0.0059	0.0079	0.0098	0.0148	0.0177	0.0197
Pumps with spec. tolerances**		Min.	0.0079	0.0079	0.0118	0.0157	0.0236	0.0276	0.0315
		Max.	0.0098	0.0118	0.0157	0.0197	0.0295	0.0354	0.0394
Stainless pumps*	-	Add 0.10 mm/0.004 inches to the above values							

Figure 42: The axial clearance in mm for the various pump sizes for standard pumps and pumps with special tolerances respectively. This table applies to pump types HD, CD, PD, GP, CC and ED. The pump size appears from the pump designation. Example: CD26EFMDK-3U332.

* Pumps made of stainless steel are set with 0.10 mm more play than specified. Pumps made of stainless steel are characterised by the figure "3" in the pump designation. Example: CD26EFMDK-3U332

** Pumps with special tolerances are identified by the inclusion of a "T" or "CHD" in the designation. Example: HD/CD41EFCHD-1M22B or GP101EDT-1U22B – see also the section "Pump versions".

20.2.2 Setting the axial clearance

Pump type		Version		Adjusting screws' min./max. angle turn in degrees											
		Standard	Special tolerances *	26/33	41	51/66	81/101	126	151	152	201				
HD (cast iron)	PD (steel)	Min.	Max.	45°	36°	54°	58°	86°	86°	86°	84°	82°			
		Min.	Max.	56°	54°	72°	72°	108°	108°	108°	108°	103°			
CD (stainless steel)	Standard	Min.	Max.	90°	72°	108°	115°	173°	173°	173°	168°	165°			
		Min.	Max.	113°	108°	144°	144°	216°	216°	216°	216°	206°			
GP (cast iron)	Standard	Min.	Max.	90°	72°	90°	86°	115°	115°	115°	108°	103°			
		Min.	Max.	101°	90°	108°	101°	137°	137°	137°	132°	123°			
ED (cast iron/steel)	Standard	Min.	Max.	90°	72°	108°	115°	173°	173°	173°	168°	165°			
		Min.	Max.	113°	108°	144°	144°	216°	216°	216°	216°	206°			
ED (stainless steel)	Standard	Min.	Max.	36°	29°	43°	58°								
		Min.	Max.	45°	43°	58°	72°								
CC (cast iron)	Standard	Min.	Max.	72°	58°	86°	115°								
		Min.	Max.	90°	86°	115°	144°								
CC (cast iron)	Special tolerances *	Min.	Max.	36°	36°	43°	58°	72°	72°	72°	96°				
		Min.	Max.	45°	54°	58°	72°	90°	90°	90°	114°				
CC (cast iron)	Special tolerances *	Min.	Max.	72°	72°	86°	115°	144°	144°	144°	144°				
		Min.	Max.	90°	108°	115°	144°	180°	180°	180°	180°				
CC (cast iron)	Special tolerances *	Min.	Max.	36°	36°										
		Min.	Max.	45°	54°										
CC (cast iron)	Special tolerances *	Min.	Max.	72°	72°										
		Min.	Max.	90°	108°										

Figure 43: Adjusting screws' min./max. angle turn in degrees – when setting the axial clearance – for the shown pump types, in the specified materials and versions.

* Pumps with special tolerances are identified by the inclusion of a "T" or "CHD" in the designation.

Example: HD/CD41EFCHD-1M22B or GP101EDT-1U22B – see also the section "Pump versions".

The pump's adjusting screws are turned in pairs to the ascertained angle – appearing from Figure 43 – to ensure straight fitting. The size of the adjusting screw angle appears from Figure 44.




Figure 44: The size of the angle for a single surface on the hexagonal bolt head on the adjusting screws.

The procedure for setting the axial clearance in the various pumps for installed and non-installed pumps re-spectively. – appears from Figure 45.

Setting of axial clearance

Non-installed pump:

Installed pump:

<p>Type HD, CD, PD:</p> <ol style="list-style-type: none"> 1. Loosen bearing covers pos. CS/CR so that the shaft can be pushed axially 2. The pump's axial clearance can be found in the table Figure 42 3. Insert an air gap gauge between the front cover and the rotor/idler 4. Push the shaft towards the front cover until the air gap gauge becomes jammed 5. Tighten the bolts in pairs so that the bearing covers do not force the ball bearing to one side 6. When adjustment is complete, make sure that the pump shaft turns easily and regularly, and that no jarring noises can be heard. 	<p>Type HD, CD, PD:</p> <ol style="list-style-type: none"> 1. Loosen bearing cover pos. CS 2. Tighten bearing cover pos. CR. 3. Loosen bearing cover pos. CR in accordance with the number of degrees obtained in the formula – Figure 43: 4. Tighten bearing cover pos. CS Tighten the bolts in pairs so that the bearing covers do not force the ball bearing to one side 5. When adjustment is complete, make sure that the pump shaft turns easily and regularly, and that no jarring noises can be heard
<p>Type CC (with shim rings):</p> <ol style="list-style-type: none"> 1. Remove set screws pos. E 2. Remove front cover pos. AA 3. Remove shim ring(s) pos. AS 4. Loosely attach front cover and set screws 5. The pump's axial clearance is obtained from the table in Figure 32 6. Insert an air gap gauge between the front cover and the rotor/idler 7. Tighten the front cover until the air gap gauge becomes jammed 8. Measure the distance between the pump casing pos. A and the front cover pos. AA: _____ 9. The figure obtained is the thickness of the new shim ring 10. Requisition and fit the shim ring or shim rings pos. AS according to the above! 11. When adjustment is complete, make sure that the pump shaft turns easily and regularly, and that no jarring noises can be heard 	<p>Type CC (with shim rings):</p> <ol style="list-style-type: none"> 1. Remove set screws pos. E 2. Remove front cover pos. AA 3. Remove shim ring(s) pos. AS 4. Re-attach the front cover and set screws, and screw the front cover to the idler 5. Check that the pump shaft <i>cannot</i> be turned (If the pump shaft can turn, this is because the front cover and/or rotor/idler are worn, and the play can thus not be set correctly. Worn items must then be replaced before resetting the axial clearance) 6. Measure the distance between the pump casing pos. A and the front cover pos. AA: _____ 7. The pump's axial clearance can be seen in the table in Figure 32: _____ 8. The two figures obtained together define the thickness of the new shim ring: _____ 9. Requisition and fit the shim ring or shim rings pos. AS according to the above! 10. When adjustment is complete, make sure that the pump shaft turns easily and regularly, and that no jarring noises can be heard
<p>Non-installed/installed pump:</p>	
<p>Type ED, CC (with set screws):</p>	

1. Loosen set screws pos. NM
2. Tighten adjusting screws pos. E until the front cover is positioned against the rotor/idler.
3. Check that the pump shaft cannot be turned
4. (If the pump shaft can turn, this is because the front cover and/or rotor/idler are worn, and the play can thus not be set correctly. Worn items must then be replaced before resetting the axial clearance)
5. Loosen adjusting screw pos. E according to the number of degrees obtained in the formula in Figure 43
6. Tighten set screws pos. NM.
7. In non-installed pumps, once adjusted the play must be checked with an air gap gauge in at least 3 different points, to ensure that the front cover is parallel with the rotor.

Finally, make sure that the pump shaft can turn easily and regularly and that no jarring sound can be heard. Finally, make sure that the pump shaft can turn easily and regularly and that no

Type GP:

1. Loosen set screw pos. DC on sleeve coupling pos. DB
2. Loosen the short set screws pos. KY
3. Tighten the long set screws pos. KX until the rotor is positioned against the front cover
4. Loosen the long set screws pos. KX according to the no. of degrees obtained in the formula in Figure 43
5. Tighten the short set screws pos. KY
6. Tighten set screw pos. DC
7. When adjustment is complete, make sure that the pump shaft turns easily and regularly, and that no jarring noises can be heard.
(The flange motor in GP pumps must have a locked bearing at the end of the shaft end, to ensure that the pump's axial clearance falls within permitted parameters)

Figure 45: The procedure for setting the axial clearance in the various pumps for installed and non-installed pumps respectively.

21 Spare parts

We recommend that you use original spare parts.

DESMI accepts no liability for any personal injury or damage to the pump as a consequence of the use of non-original spare parts that do not satisfy precisely the same strict quality requirements as original DESMI spare parts.


22 Ordering spare parts

When ordering spare parts, the following information must be provided:

- The pump's serial number	252756
- The pump's SX no.	5310
- The pump type	HD81ERM-1U332
- If relevant, the code of the mechanical shaft seal	AD
- If relevant, the number of the magnetic coupling (seal)	-
- If relevant, the number of the bypass valve	-
- The spare part's position designation	Pos. CJ
- The spare part's designation	Mechanical shaft seal

The above information may be found on the pump's name plate – Figure 45.
The serial number is also embossed on the pump's left port.


Figure 46: An example of a pump's name plate.

ROTAN [®] PUMP			
HD81ERM-1U332			
SX.	5310	NO.	252756
VALVE		SEAL	AD
	DESMI INC. 2551 Eltham Ave Norfolk, Virginia 23513		
MADE IN DENMARK			


22.1 Spare parts drawings

This section contains a representative selection of ROTAN sectional drawings. Not all pump configurations are included, but taken together the drawings selected show the most common position designations and designs.


CD/PD..EFDKMMW - (CD/PD..EFMM) - (CD/PD..EFMMP)

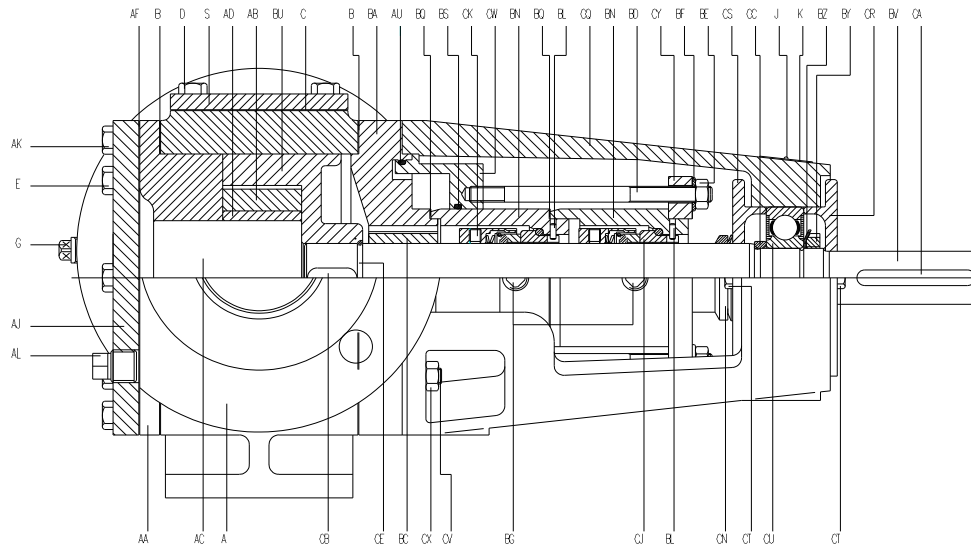


MM

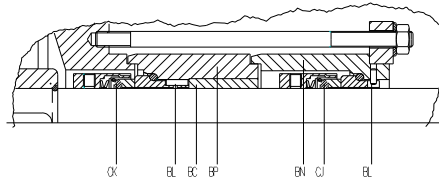



MMP

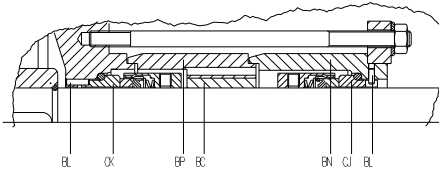

CD/PD..EF

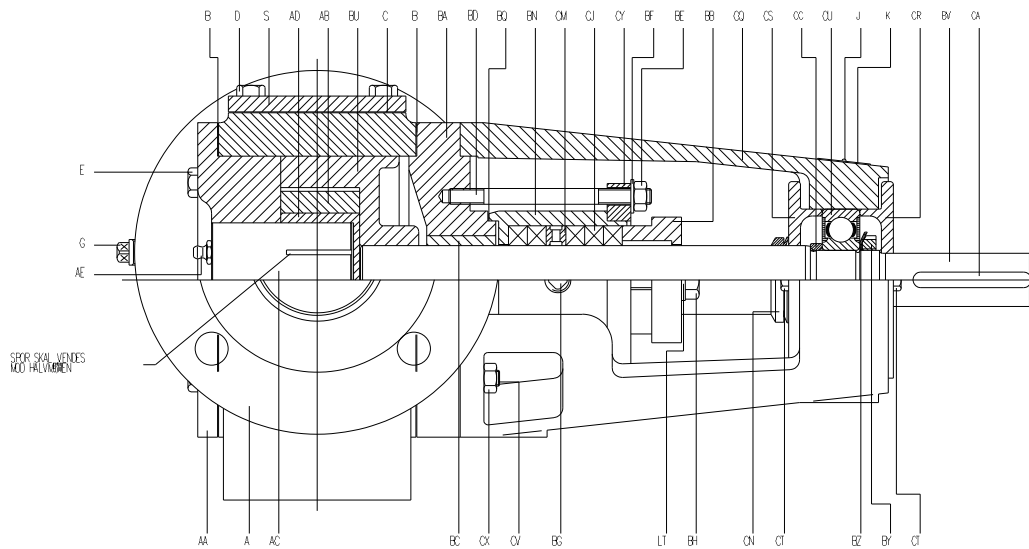


HD..EDK
(GP..E)
(HD..ECHD)

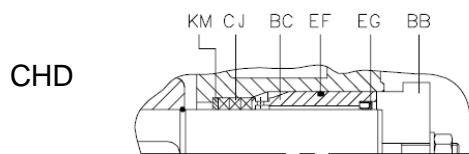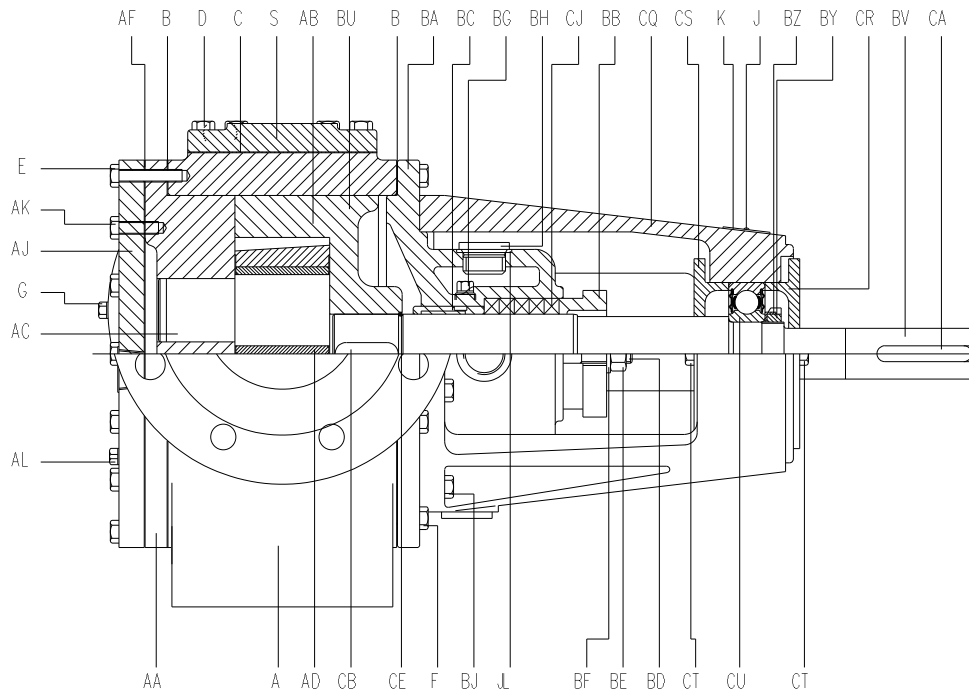


GP..EM
(HD..EM)


Grove must
face
crescent

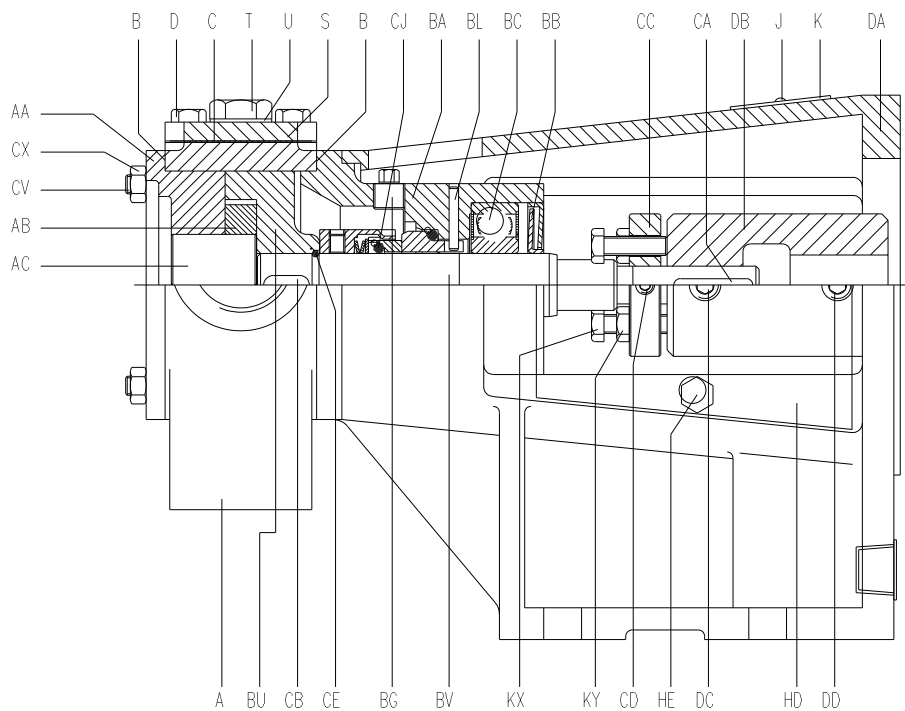

ED...EFDK

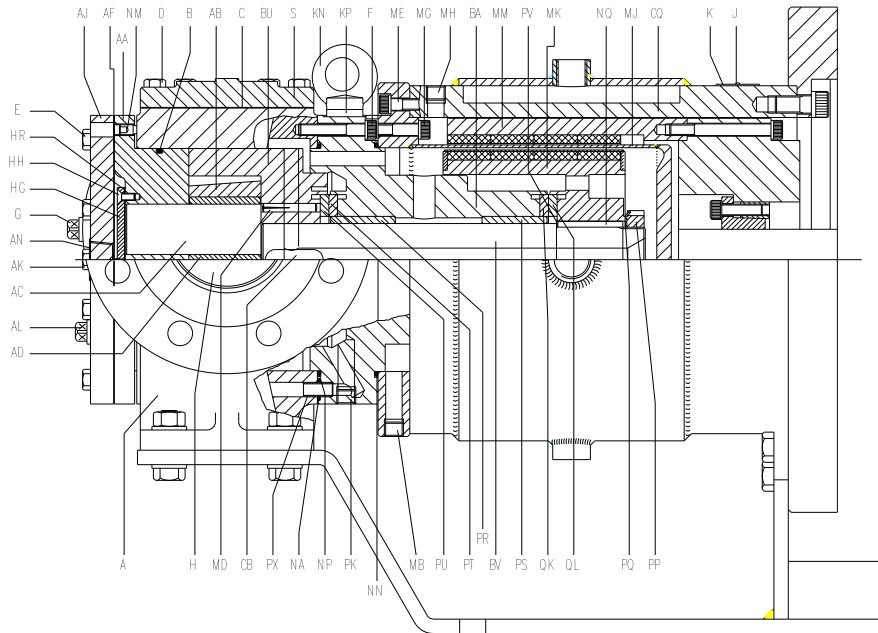

Bypass valve for HD, GP (CD, PD, ED)

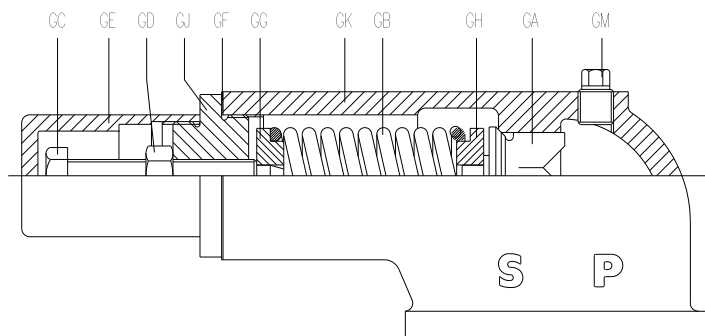

23 spare part list

<u>Pos.</u>	<u>Designation</u>	<u>Pos.</u>	<u>Designation</u>
A	Pump casing	BN	Shaft seal housing
B	Gasket/O-ring	BP	Intermediate bearing
C	Gasket	BQ	Gasket
D	Bolt	BR	Spacer ring
E	Bolt	BS	O-ring
F	Bolt	BU	Rotor
G	Pipe plug	BV	Shaft
J	Drive screw	BY	Ball bearing nut
K	Name plate	BZ	Ball bearing lock ring
S	Blind cover	CA	Key
T	Pipe plug	CB	Key
U	Gasket	CC	Fixing ring/spacer ring
AA	Front cover	CD	Threaded screw
AB	Idler	CE	Snap ring
AC	Idler pin	CJ	Packing coil/mechanical shaft seal
AD	Idler bush	CK	Mechanical shaft seal
AE	Lubrication nipple/pipe plug	CM	Lantern ring
AF	Gasket	CN	V-ring
AJ	Heating jacket	CQ	Bearing bracket
AK	Bolt	CR	Bearing cover
AL	Pipe plug	CS	Bearing cover
AU	O-ring	CT	Bolt
BA	Rear cover	CU	Ball bearing
BB	Packing gland/bearing cover	CV	Stud bolt
BC	Main bearing bush/ Ball bearing	CW	Heating jacket
BD	Stud bolt/bolt	CX	Nut
BE	Nut	CY	Retaining flange
BF	Washer	DA	Motor bracket
BG	Pipe plug/lubrication nipple	DB	Coupling
BH	Bolt/pipe plug	DC	Threaded screw
BJ	Bolt	DD	Threaded screw
BL	Priming pin	EF	O-ring

<u>Pos.</u>	<u>Designation</u>	<u>Pos.</u>	<u>Designation</u>
EG	Seal ring	MP	Bolt
EJ	Bolt	MQ	Bolt
GA	Valve cone	MR	Lock ring
GB	Key	MS	Key
GC	Adjusting screw	MT	Seal ring
GD	Nut	MU	Connecting flange
GE	Canister	MV	Complete main bearing
GF	Gasket	MW	Spacer ring
GG	Pressure plate	MX	Bolt
GH	Pressure plate	MY	Cylindrical pin
GJ	Valve cover	MZ	O-ring
GK	Valve casing	NA	O-ring
GM	Pipe plug	NB	Ball bearing
GN	Gasket	NC	Thermal sensor
GQ	Bolt	ND	Bearing cover
GR	Washer	NE	Shaft
HD	Shield	NF	Cover
HE	Bolt	NG	Disc spring
JL	Gasket	NJ	Bolt
KX	Bolt	NK	O-ring
KY	Bolt	NM	Set screw
LT	Washer	NN	O-ring
MA	O-ring	NP	O-ring
MB	Pipe plug	NQ	Key
MC	O-ring	NS	Intermediate piece
ED	Roll pin	NT	Thread fitting
ME	Bolt	NU	O-ring
MF	Bolt	NZ	Draining plug
MG	Bolt		
MJ	Canister		
MK	Inner magnetic rotor		
ML	Bolt		
MM	Outer magnetic rotor		
MN	Washer		

24 Technical specifications

Because of the ROTAN pump's large number of possible combinations and the many pump liquids used, the following values should be viewed as guideline maximum values, as an individual ROTAN pump may have further limitations due to the pump liquid, the shaft seal selected and in particular the motor selected.

If the pump was bought in Denmark, we therefore refer to DESMI's service centres at the back of this manual.

If the pump was bought outside Denmark, we refer to the relevant distributor.

The technical specifications of the motor are contained in the manual supplied by the motor manufacturer.

24.1 Capacity

Pump type	Capacity in m ³ /h	Capacity in USGPM
GP	Maximum 50 m ³ /h	Maximum 183 USGPM
ED	Maximum 90 m ³ /h	Maximum 330 USGPM
HD/PD/CD	Maximum 170 m ³ /h	Maximum 623 USGPM
CC	Maximum 6,8 m ³ /h	Maximum 25 USGPM

Figure 47: The maximum capacity in m³/h/ USGPM for the various pump types.

24.2 Speed

Pump size	Speed
26 / 33 / 41	Max. 1,750 o/min.
51 / 66	Max. 1,450 o/min.
81	Max. 1,200 o/min.
101	Max. 950 o/min.
126	Max. 750 o/min.
151	Max. 600 o/min.
152	Max. 500 o/min.
201	Max. 400 o/min.

Figure 48: The maximal speed per minute for the various pump sizes – for pump liquids with viscosities under 400 cSt. Reduce the speed in the event of higher viscosities in order to avoid cavitation.

The table applies to all pump types: GP/HD/PD/CD/ED/CC.

24.3 Operational pressure

Pump type/size	Operating pressure – pump casing in bar	Operating pressure – heat chamber in bar	Operating pressure – pump casing in psi	Operating pressure – heat chamber in psi
GP*/HD/PD/CD/ED 26 / 33 / 41 / 51 / 66 / 81	Maximum 16 bar (maximum 25 bar*)	Maximum 10 bar	Maximum 232 psi (maximum 362 psi*)	Maximum 145 psi
GP*/HD/PD/CD/ED 101 / 126 / 151 / 152 / 201	Maximum 10 bar (maximum 25 bar*)	Maximum 10 bar	Maximum 145 psi (maximum 362 psi*)	Maximum 145 psi
CC	Maximum 10 bar		Maximum 145 psi	

Figure 49: Maximum operational pressure in bar for the various pump types.
The stated max. operational pressure depends on the inlet pressure to the pump and the pump size.

* Pump type GP is also supplied in a special high-pressure version which manages a max. of 25 bar/362.5 psi.

The high-pressure version is available in pump sizes: 27 / 34 / 42 / 52 / 67 / 82/ 102
It appears from the pump size on the name plate if the pump can manage max. 25 bar/362.5 psi.

System pressure + differential pressure must not exceed 25 bar/362,5 psi.
The differential pressure must not exceed 16 bar/232 psi. for pump size sup to 82 and 10 bar/145 psi. for size 102.

24.4 Suction height

Pump type	Suction lift in bar	Suction lift in psi
GP/HD/PD/CD/ED/CC	Maximum 0.5 bar priming vacuum	Maximum 7.3 psi priming vacuum
	Maximum 0.8 bar vacuum during operation	Maximum 11.6 psi vacuum during operation

Figure 50: The max. suction height in bar/psi. for priming vacuum and operational vacuum.

24.5 Viscosity

Pump type	Viscosity in cSt	Seybold Seconds Universal (SSU)
GP	Maximum 7.500 cSt	Maximum 35.000 SSU
ED	Maximum 10.000 cSt	Maximum 46.000 SSU
HD/PD/CD	Maximum 75.000 cSt	Maximum 346.000 SSU
CC	Maximum 1.000 cSt	Maximum 4.600 SSU

Figure 51: States the max. allowed viscosity in cSt/SSU of the pump liquid – for standard versions of the various pump types.

24.6 Temperature

Pump type	Temperature in C	Temperature in F
GP	Maximum 150°C	Maximum 302°F
HD/PD/CD*	Maximum 250°C	Maximum 482°F
ED	Maximum 130°C (Magnetic material: Neodymium-Iron-Boron)	Maximum 266°F (Magnetic material: Neodymium-Iron-Boron)
	Maximum 250°C (Magnetic material: Samarium-Cobalt)	Maximum 482°F (Magnetic material: Samarium-Cobalt)
CC	Maximum 80°C	Maximum 176°F

Figure 52: The pump liquid's minimum/maximum temperature limits for the various pump types. For pumps with bypass valve the temperature is limited to 150°C/302°F on account of the valve spring. The valve may however be supplied with another spring so that the temperature span of the pump can be utilised fully.

As or additional temperature limits, see the section: "Hot liquids".

* Pump types HD, CD og PD – designed with special tolerances – may in certain cases be use dup to 300°C/572°F.

ED pumps			
Elastomer type	Elastomer brand	Temperature in C	Temperature in F
FPM	Viton®	Approx. -25°C/+170°C	Approx. -13°F/+338°F
FEP	Teflon® with Viton core	Approx. -60°C/+205°C	Approx. -76°F/+401°F
EPDM	Ethylene-propylene	Approx. -65°C/+120°C	Approx. -85°F/+248°F
FFKM	Kalrez®	Approx. -50°C/+316°C	Approx. -58°F/+601°F

Figure 53: The pump liquid's minimum/maximum temperature limits for the various elastomers used in an ED pump.

25. Installation of ATEX pumps with PT100 sensor

To ensure that a Rotan ATEX pump is safe to use in a ATEX area the following chapters must be followed.

ED pumps and pumps with soft shaft seal, must always be installed with a PT100 sensor according to Desmi A/S instructions.

If the Rotan ATEX pump is fitted with a bypass valve, a PT100 sensor is to be mounted on the bypass valve.

If a Rotan ATEX pump is ordered with PT100 sensors, the PT100 sensors is not mounted from the factory, because there is a risk of damaging it under transport.

The PT100 sensor must be mounted before use of the pump, according to Desmi A/S instructions.

25.1 Installation of the PT100 sensor

25.1.1 PT100 sensor installed in intrinsically safe electrical circuit

If the PT100 sensor is installed in intrinsically safe electrical circuit, there is no demand, that the PT100 sensor is to be certified by the ATEX directive. It is a simple apparatus according to EN60079-14:2004 §3.4.5

The intrinsically safe electrical circuit is to be installed according to EN 60079-14:2004

Desmi A/S recommend mounting of intrinsically safe electrical circuit

25.1.2 PT100 installed as a intrinsically safe equipment

The PT100 sensor must be classified after the same ATEX zone as the pump
The PT100 sensor must be certified according to the ATEX zone where they are installed
The installation is to be made after the rules in EN 60079-14:2004

When ordering a Rotan ATEX pump, it is important that it is stated if the pump is to be delivered with or without PT100 sensor.

If Desmi is to deliver the PT100 sensor from the factory it is important that it is informed. If the PT100 sensor is installed in a intrinsically safe electrical circuit or not. If this information not can be informed. Desmi will deliver a PT100 sensor according to 25.1.b

25.2 Mounting of the PT100 sensor on the pump

The following mounting instruction must be followed to insure that the Rotan ATEX pump is safe to use in a ATEX zone

Rotan ATEX pumps that is to be installed with PT100 sensors is always prepared for mounting of the sensors from the factory. If the Pump is ordered without PT100 sensors, these mounting places must be used.

25.2.1 Pumps with soft shaft seal

When mounting the PT100 sensor in the pump. Put a small amount of heating conductive paste on the tip of the sensor, to insure a good heat transfer between the soft seal, rear cover and the sensor.

Turn The counter nut totally back. Mount the PT100 sensor through the bracket, and in to the hole on the rear cover. When the sensor tip touch the bottom of the hole, turn the sensor $\frac{1}{4}$ revolution back, and tighten the counter nut.

25.2.2 ED Pumps

When mounting a PT100 sensor on a ED pump. Put a small amount of heating conductive paste, on the tip of the sensor, to insure a good heat transfer from the canister that surrounds the media in the pump and the sensor.

Turn the counter nut on the sensor totally back. Mount the PT100 sensor on the pump rear cover. Turn the sensor in until it touches the canister, when the sensor tip touches the canister turn it $\frac{1}{4}$ revolution back, and tighten the counter nut.

25.2.3 Bypass valve

When mounting a PT100 sensor on a bypass valve. The sensor is mounted in a sensor pocket. The sensor pocket is always mounted on the bypass valve pressure side, marked "P". Put a small amount of heating conductive paste on the tip of the sensor, to insure a good heating transfer between the sensor pocket and the sensor. The counter nut is turned totally back, and the sensor is mounted on the sensor pocket, turn the sensor in the sensor pocket until the tip of the sensor touches the bottom, then turn it $\frac{1}{4}$ revolution back, and tighten the counter nut.

25 Service centres - Denmark

Service center - Denmark	
Nøresundby Tagholm 1 DK-9400 Nørresundby Tel: +45 70236363 Fax: +45 9817 5499	Kolding Albuen 18 C DK-6000 Kolding Tel: +45 7023 6363 Fax: +45 75 58 34 65
Århus Lilleringvej 20 DK-8462 Hårlev J Tel: +45 7023 6363 Fax: +45 8694 2292	Hvidovre Stamholmen 173 DK-2650 Hvidovre Tel: +45 70236363 Fax: +45 3677 3399
Odense Hestehaven 61 DK-5260 Odense S Tel: +45 70236363 Fax: +45 6595 7565	

26 Subsidiary companies–DESMI Pumping Technology A/S

Subsidiary companies – DESMI Pumping Technology A/S	
DESMI Denmark A/S Address: Tagholm 1,DK-9400 Nørresundby Denmark Tel: +45 7244 0250 Fax: +45 9817 5499	DESMI Inc. Address: 1119 Cavalier Blvd, Chesapeake Virginia 23323, USA Tel.: +1 757 857 7041 Fax.: +1 757 857 6989
DESMI Contracting A/S Address: Tagholm 1,DK-9400 Nørresundby Denmark Tel.: +45 96 32 81 11 Fax: +45 98 17 54 99	DESMI Pumping Technology (Suzhou) Co., Ltd Address: No 740 Fengting avenue, Weiting Sub-District 215122 SIP Suzhou, China Tel.: +86 512 6274 0400 Fax.: +86 512 6274 0418
DESMI GmbH Address: An der Reitbahn 15 21218 Seevetal, Germany Tel.: +49 40 7519 847 Fax: +49 40 7522 040	DESMI Korea Address: 905 ,Western Tower I, Janghang-dong 867, Ilsandong-gu, Goyang, Gyeonggi 410-838, Korea Tel.: +82 31 931 5701 Fax.: +82 31 931 5702
DESMI Ltd. Address: "Norman House" Rosevale Business Park, Parkhouse industrial Estate (West) Newcastle, Staffordshire ST5 7UB, England Tel.: +44 1782 566 900 Fax.: +44 1782 563 666	DESMI Singapore Pte.Ltd Address: No. 8 Kaki Bukit Road 2, Ruby Warehouse Complex Unit no: # 02-16 Singapore 417841 Tel.: +65 6748 2481 Fax.: +65 6747 6172
DESMI B.V Address: Texasdreef 7,3565 CL Utrech Netherlands Tel.: +31 302 610 024 Fax.: +31 302 623 314	DESMI India Address: 413,Adity Trade Centre Ameerpet, Hyderabad - 500016 Tel.: +91 9949339054
DESMI Norge AS Address: Vigevejen 46, 4633 Kristiansand S, Norway Tel.: +47 38 122 180 Fax.: +47 38 122 181	DESMI Africa Address: Plot No.1848 Yarht Club Road Msasani Peninsular, Dar es Salaam,Tanzania Tel. +255 769756919

